



TOP VIEW

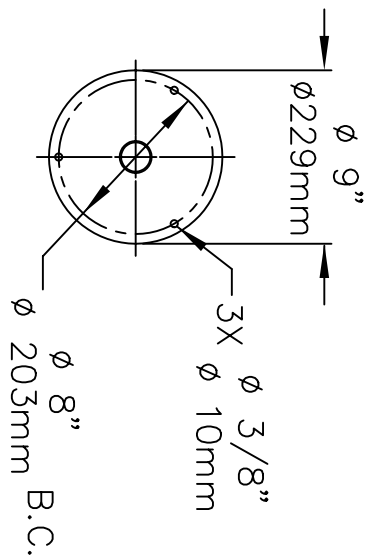

MOUNTING DETAIL

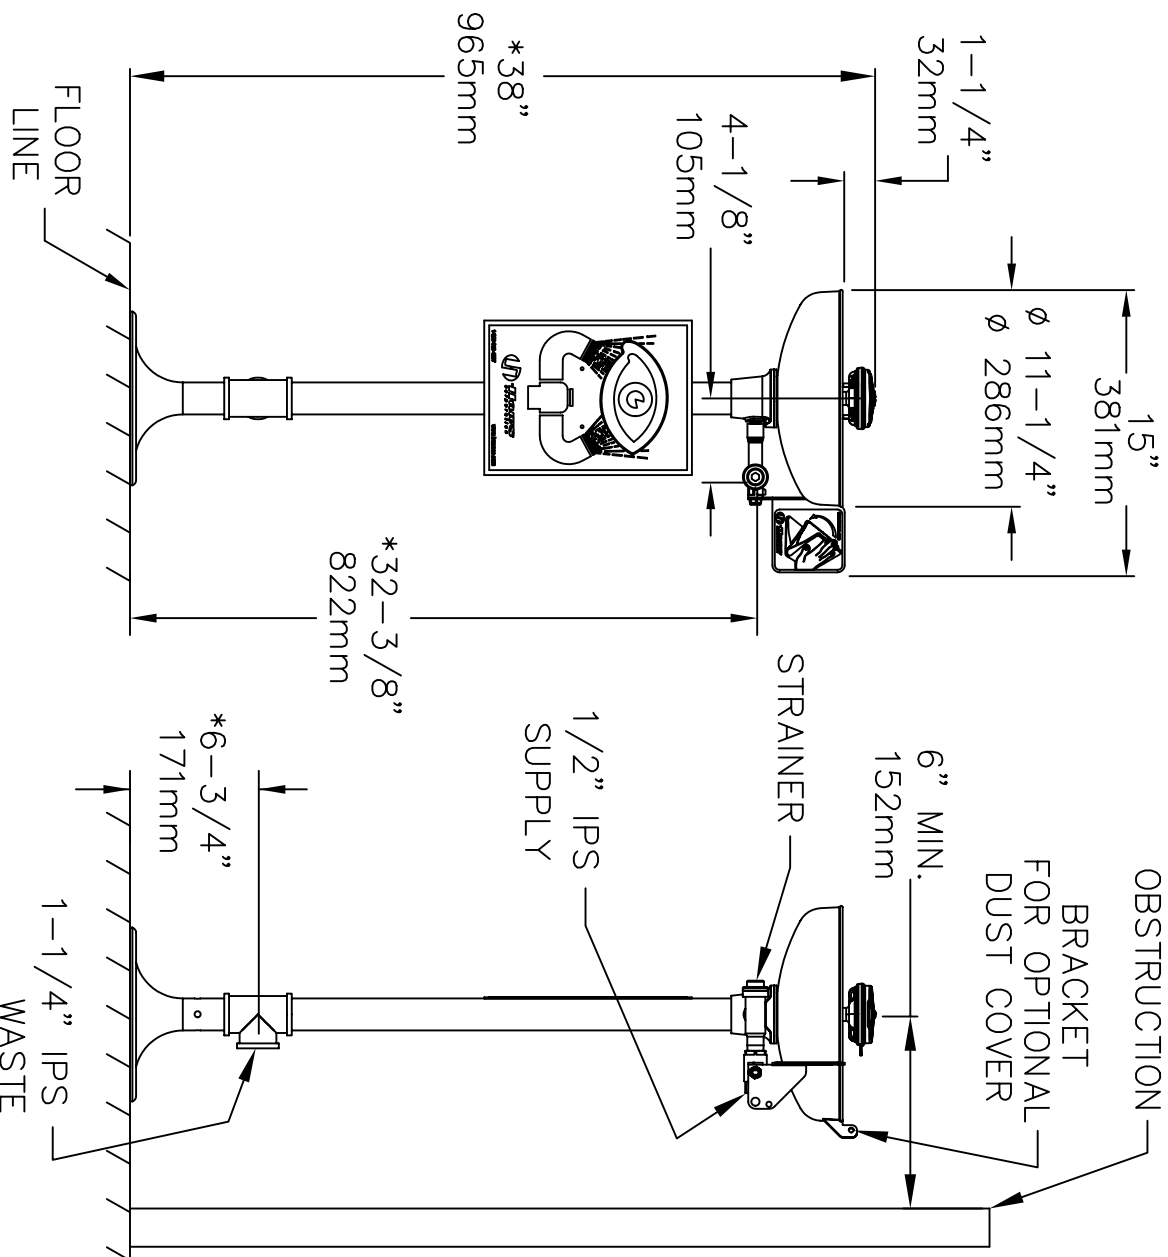

NOTES:

1. TO COMPLY WITH ANSI Z358.1-2009 FOR EMERGENCY EYEWASH AND EYE/FACE WASH:
 - UNIT SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS AND ACCEPTABLE PLUMBING PRACTICES.
 - EYEWASH OR EYE/FACE WASH SHALL BE POSITIONED WITH NOZZLES NOT LESS THAN 83.8 CM (33IN.) AND NO GREATER THAN 114.3 CM (45 IN.) FROM SURFACE ON WHICH USER STANDS AND 15.3 CM (6 IN.) MINIMUM FROM WALL OR NEAREST OBSTRUCTION.
2. *THESE DIMENSIONS MAY VARY \pm 1/2" [12.7mm]



1455 KLEPPE LANE
 SPARKS, NEVADA 89431
 (775) 359-4712 FAX (775) 359-7424
 E-MAIL: HAWS@HAWS.CO.COM
 WEBSITE: WWW.HAWS.CO.COM

EQ. NO.	726117271	MODEL(S):	726117271, 7261CRP, 7271CRP
DATE:	04/92	LINEO. FAX. DOC. #:	27261, 27271
APPROVED:		INSTALLATION/EXERCISE:	
SIZE:	A	SHEET:	1 OF 1
DATE:	02/08	REVISED:	04/3 D
BY:		REVISED:	09398A00
			15