


IMPORTANT
SUPPLY MUST BE HEAT TRACED AND INSULATED

NOTES:

1. DIMENSIONS IN BRACKETS ARE IN MILLIMETERS.
2. UNLESS OTHERWISE SPECIFIED ALL TOLERANCES TO BE +/- 1/4 INCH.
3. TO COMPLY WITH ANSI Z358.1-2009 FOR EMERGENCY EYE/FACE WASH AND SHOWER EQUIPMENT:
 - UNIT SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS AND ACCEPTABLE PLUMBING PRACTICES.
 - EYE/FACE WASH SHALL BE POSITIONED WITH NOZZLES NOT LESS THEN 83.8 CM (33 IN.) AND NO GREATER THAN 114.3 CM (45 IN.) FROM SURFACE ON WHICH USER STANDS AND 15.3 CM (6 IN.) MINIMUM FROM WALL OR NEAREST OBSTRUCTION.
 - SHOWER SHALL BE POSITIONED SO THAT SHOWER HEAD IS NOT LESS THAN 208.3 CM (82 IN.) NOR MORE THAN 243.8 CM (96 IN.) FROM SURFACE ON WHICH USER STANDS.
 - SHOWER SPRAY PATTERN SHALL HAVE A MINIMUM DIAMETER OF 50.8 CM (20 IN.) AT 152.4 CM (60 IN.) ABOVE SURFACE ON WHICH USER STANDS, AND CENTER OF SPRAY PATTERN SHALL BE LOCATED AT LEAST 40.6 CM (16 IN.) FROM ANY OBSTRUCTION.

		Haws®		1455 KLEPPE LANE SPARKS, NEVADA 89431 (775) 359-4712 FAX (775) 359-7424 E-MAIL: HAWS@HAWSCO.COM WEBSITE: WWW.HAWSCO.COM	
				ECN NO: 4140 DRAWN: SLS APPROVED:	REVISED PER: IR DATE: 7/17/08 DATE:
SCALE: 1:1		DRAWING TYPE: INSTALLATION		SIZE: A SHEET 1 OF 2	

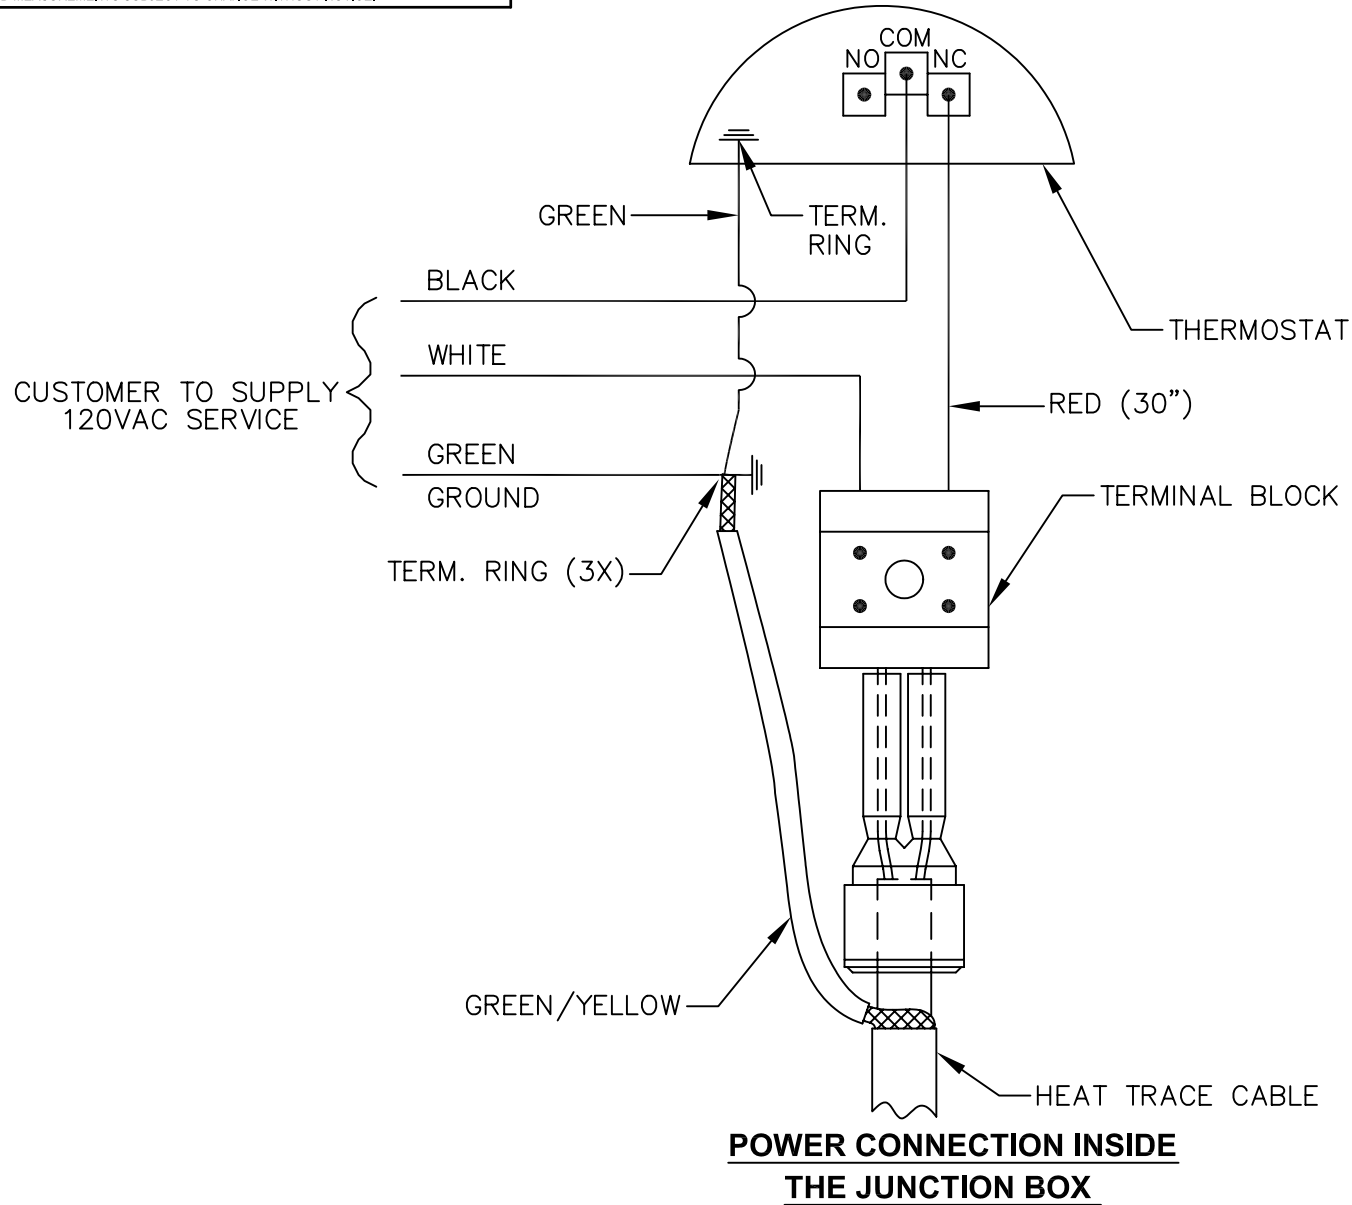

**POWER CONNECTION INSIDE
THE JUNCTION BOX**

ELECTRICAL SCHEMATIC

			1455 KLEPPE LANE SPARKS, NEVADA 89431 (775) 359-4712 FAX (755) 359-7424 E-MAIL: HAWS@HAWS.CO.COM WEBSITE: WWW.HAWS.CO.COM	
			ECN NO: 4140 DRAWN: SLS APPROVED:	REVISED PER: IR DATE: 7/17/08 DATE:
SCALE: 1:1		DRAWING TYPE: INSTALLATION	SIZE: A	SHEET 2 OF 2