

FEATURES & BENEFITS

OPTIONS

For more information, visit www.hawsco.com or call (888) 640-4297.



SPECIFICATIONS

Model 8317IDLTEXP is an indicator light kit for the 8317CTFP series showers. When lit, the light indicates power is being supplied to heat traced cable on model. Model is QPS-C-US Certified, TYPE 4. For Class 1, Div. 2, Group B, C & D. Tempering code T6; only when used with 8317CTFP.



APPLICATIONS

Model is CSA electrical certified, TYPE 4. For Class 1, Div. 2, Group B, C & D – Tempering code T6; only when used with 8317CTFP.



NOTES:

1. THERMOSTAT IS HERMETICALLY SEALED. INDICATOR LIGHT IS NON ARCING DEVICE WITH GASKETED JUNCTION BOX SUITABLE FOR CLASS I, DIVISION 2, GROUP B,C,D AREAS BUT NOT SUITABLE FOR DIVISION 1 AREAS.
2. INSTALLER MUST USE THREAD SEALANT SUCH AS APPLETON TLC-3, RECOMMENDED FOR USE IN HAZARDOUS LOCATIONS ON ALL ELECTRICAL NPT CONNECTIONS.
3. ALL INSTALLATIONS MUST BE INSTALLED IN COMPLIANCE WITH LOCAL, STATE, AND/OR FEDERAL CODES.
4. **WARNING:** WHEN INSTALLED ON 8317CTFP, THE COMBINED ASSEMBLY IS ONLY RATED FOR CLASS 1, DIVISION 2, GROUP D.

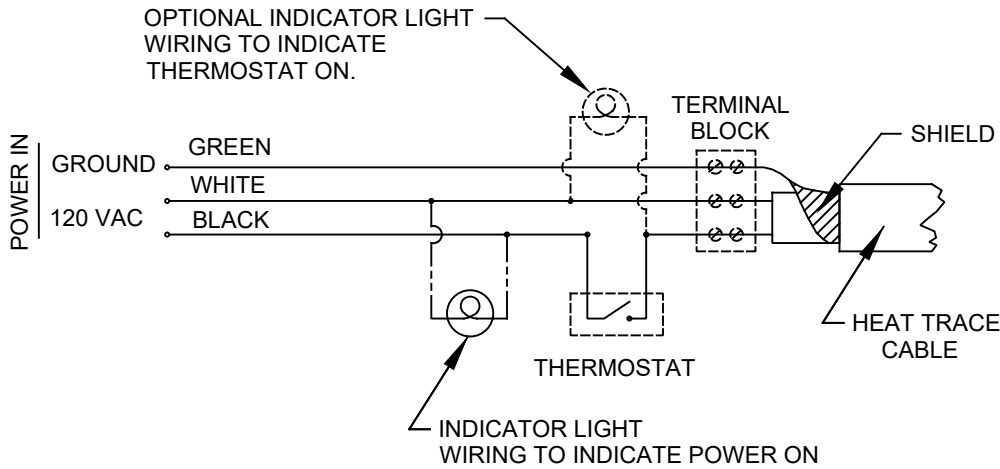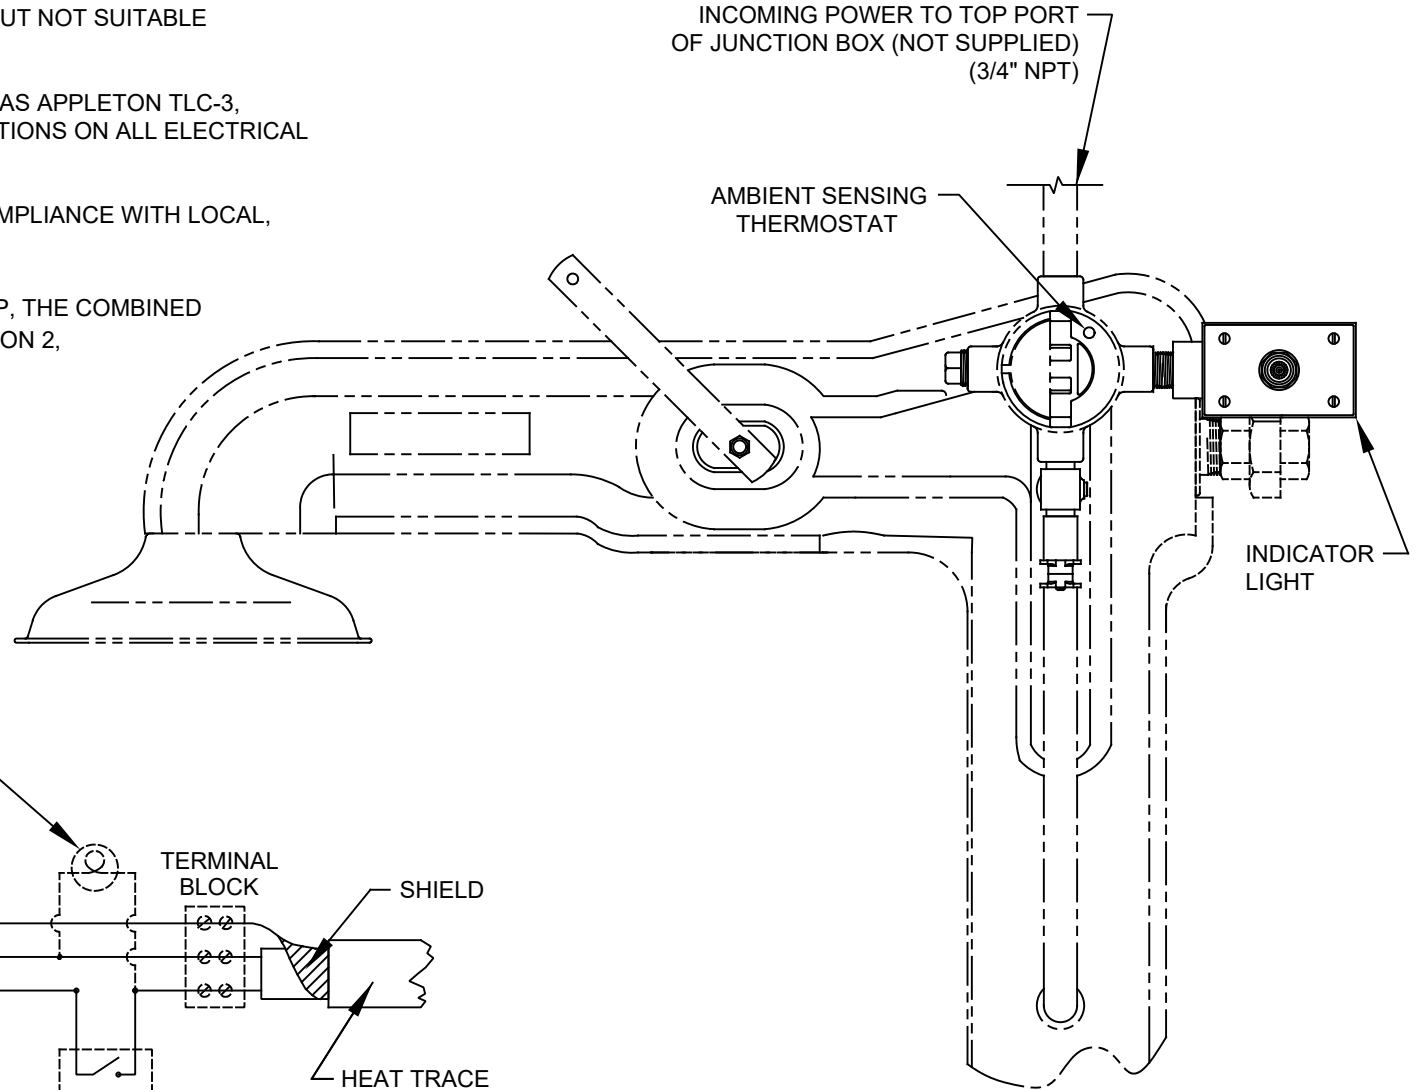

8317 INDICATOR LIGHT KIT INSTALLATION

| | | | |
|----------------------------|---|---|---------------------------|
| | | 1455 KLEPPE LANE SPARKS, NEVADA 89431 (775) 359-4712 FAX (775) 359-7424 E-MAIL: HAWS@HAWSCO.COM WEBSITE: WWW.HAWSCO.COM | |
| | | MODEL(S) 8317IDLTEXP | PART NUMBER 0002080159 |
| ECN NO. 4301 DRAWN: TRF | REVISED PER: ECN: 5775 DATE: 02/90 APPROVED: FV | BY: FV CHK'D: JS DATE: 02/22/22 | REVISION 7 |
| SCALE: 1:1 | | DRAWING TYPE: INSTALLATION | SIZE: A SHEET 1 OF 1 |