


NOTES:

1. EXISTING 1/8" NPT CHECK VALVE MUST BE RECONNECTED TO PRESSURE DRAIN VALVE REPLACEMENT TO ENSURE PROPER OPERATION.
2. NOTE DIRECTION OF FLOW ON CHECK VALVE.

VALVE CLOSES AT PRESSURES OF 10 PSI OR ABOVE.

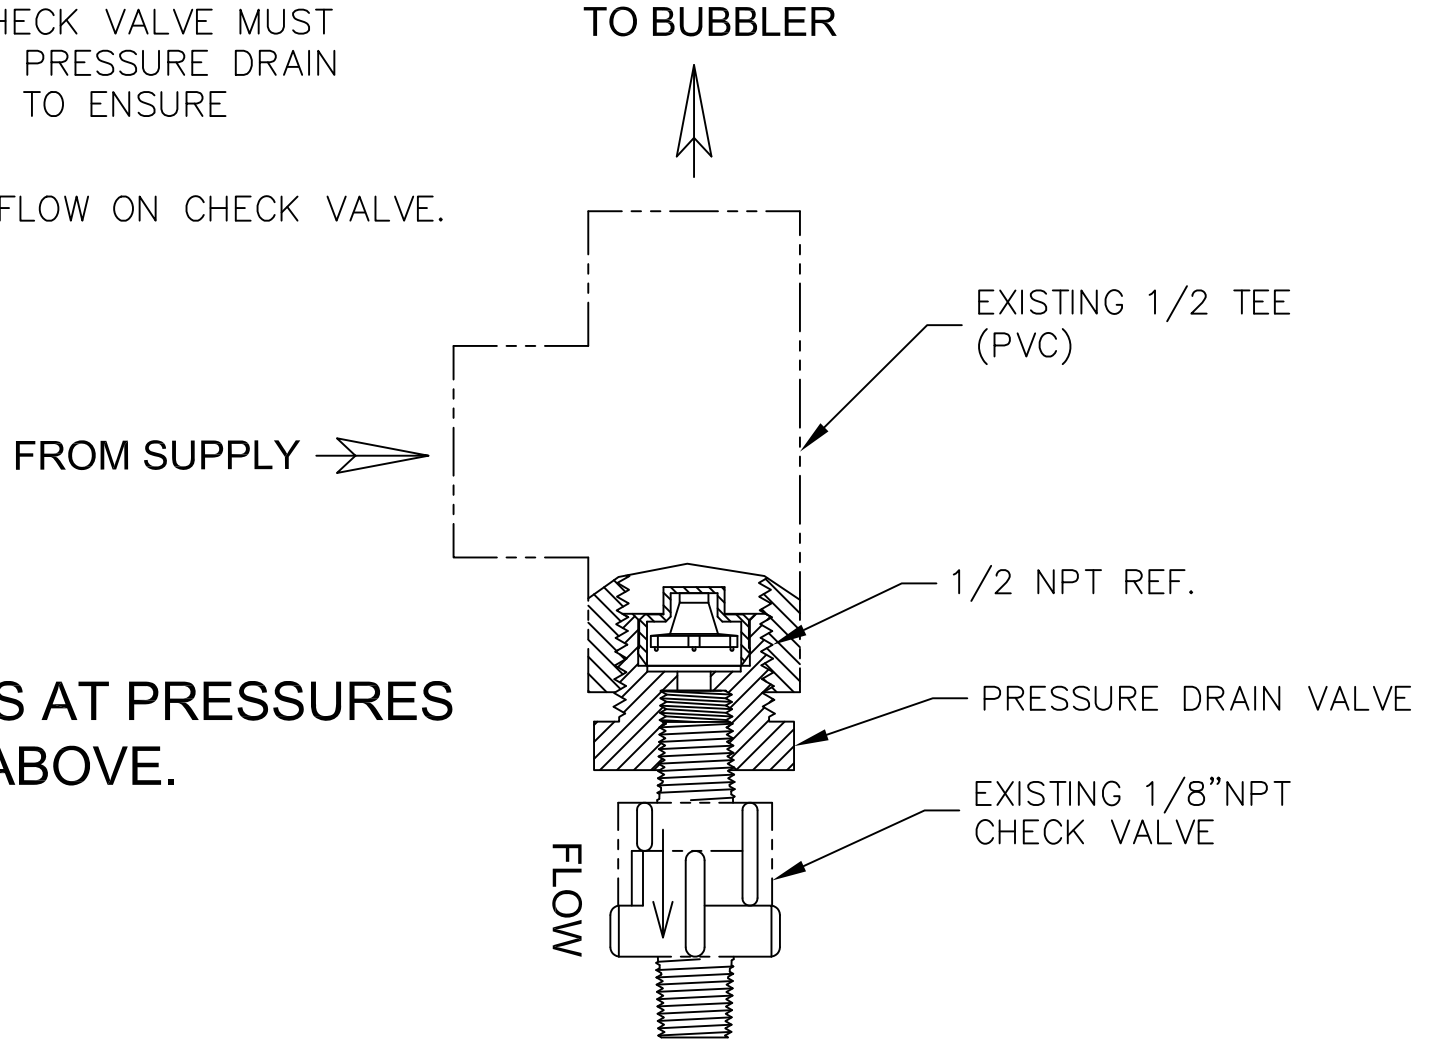

INFO FAX : 1-888-FAX-HAWS (1-888-329-4297)
1455 Kleppe Ln, Sparks NV, 89431
Phone: 775-359-4712 Fax: 775-359-7424
Haws Ag Bachweg 3 CH-3401 Burgdorf Switzerland
Haws Mfg Pte Ltd 74 Sungei Kadut Loop Singapore 729531
e-mail: Haws@hawsco.com website: www.hawsco.com

ECR NO.	REVISED PER	BY:	MODEL(S):	PART NUMBER:
	ECN: 3907	JHM	6518FRDV	0002077790
DRAWN:	DATE:	CHKD.:	INFO FAX DOC #:	DRAWING NUMBER:
J.F.	08/24/99		26518FRDV	14251C00
APPROVED:	DATE:	SCALE:	DRAWING TYPE:	SIZE: A SHT. 1 OF 1
		1:1	INSTALLATION/FAXBACK	