
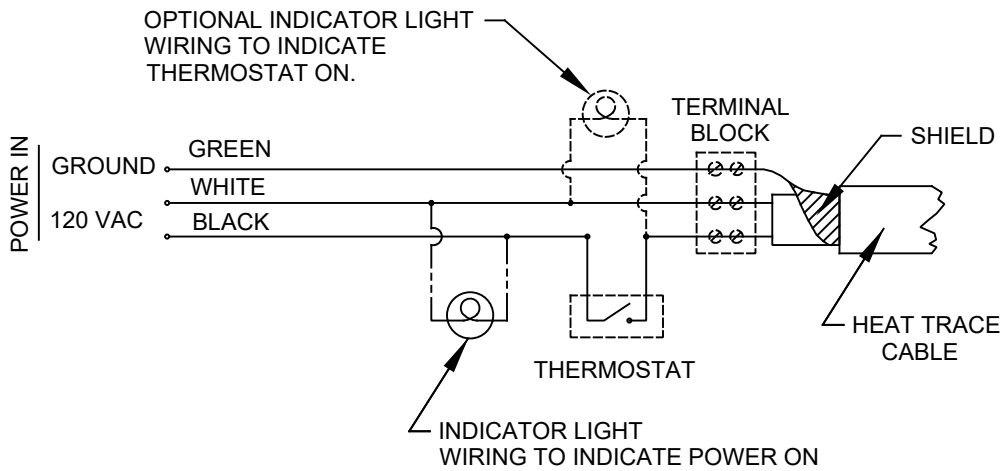


NOTES:

1. THERMOSTAT IS HERMETICALLY SEALED. INDICATOR LIGHT IS NON ARCING DEVICE WITH GASKETED JUNCTION BOX SUITABLE FOR CLASS I, DIVISION 2, GROUP B,C,D AREAS BUT NOT SUITABLE FOR DIVISION 1 AREAS.
2. INSTALLER MUST USE THREAD SEALANT SUCH AS APPLETON TLC-3, RECOMMENDED FOR USE IN HAZARDOUS LOCATIONS ON ALL ELECTRICAL NPT CONNECTIONS.
3. ALL INSTALLATIONS MUST BE INSTALLED IN COMPLIANCE WITH LOCAL, STATE, AND/OR FEDERAL CODES.
4. **WARNING:** WHEN INSTALLED ON 8317CTFP, THE COMBINED ASSEMBLY IS ONLY RATED FOR CLASS 1, DIVISION 2, GROUP D.

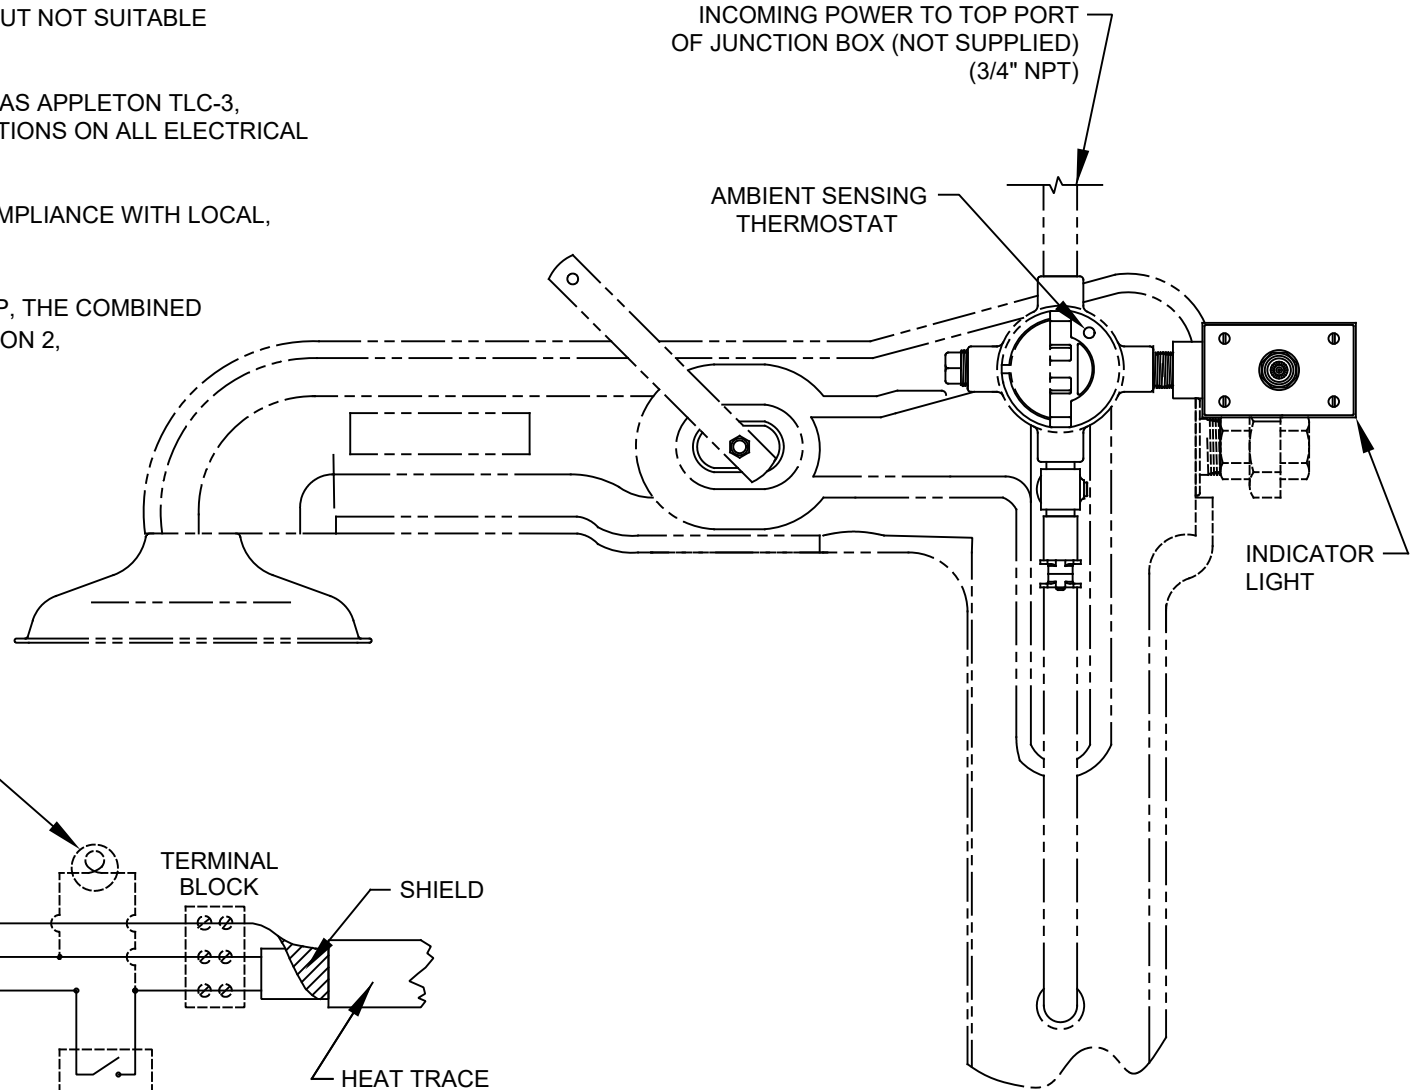

8317 INDICATOR LIGHT KIT INSTALLATION

		1455 KLEPPE LANE SPARKS, NEVADA 89431 (775) 359-4712 FAX (775) 359-7424 E-MAIL: HAWS@HAWS.CO.COM WEBSITE: WWW.HAWS.CO.COM	
		MODEL(S) 8317IDLTEXP	PART NUMBER 0002080159
ECN NO. 4301 DRAWN: TRF	REVISED PER: ECN: 5775 DATE: 02/90 APPROVED: FV	BY: FV CHK'D: JS DATE: 02/22/22	REVISION 7
SCALE: 1:1		DRAWING TYPE: INSTALLATION	SIZE: A SHEET 1 OF 1