


NOTES:

1. AUDIBLE AND VISIBLE ALARM ACTIVATED WHEN SHOWER OR EYEWASH IS IN USE.
2. 120VAC SUPPLY VOLTAGE REQUIRED, APPROXIMATELY 100VA ALL ELECTRICAL HOOKUPS TO MAIN JUNCTION BOX.
3. SYSTEM CERTIFIED AS SUITABLE FOR CLASS I, DIV. 2 GROUPS B, C, D LOCATION INSTALLATION. INSTALLER MUST USE THREAD SEALANT, SUCH AS APPLETON TLC3, RECOMMENDED FOR USE IN HAZARDOUS LOCATIONS ON ALL ELECTRICAL NPT CONNECTIONS.

(CONTINUED ON SHEET 2)

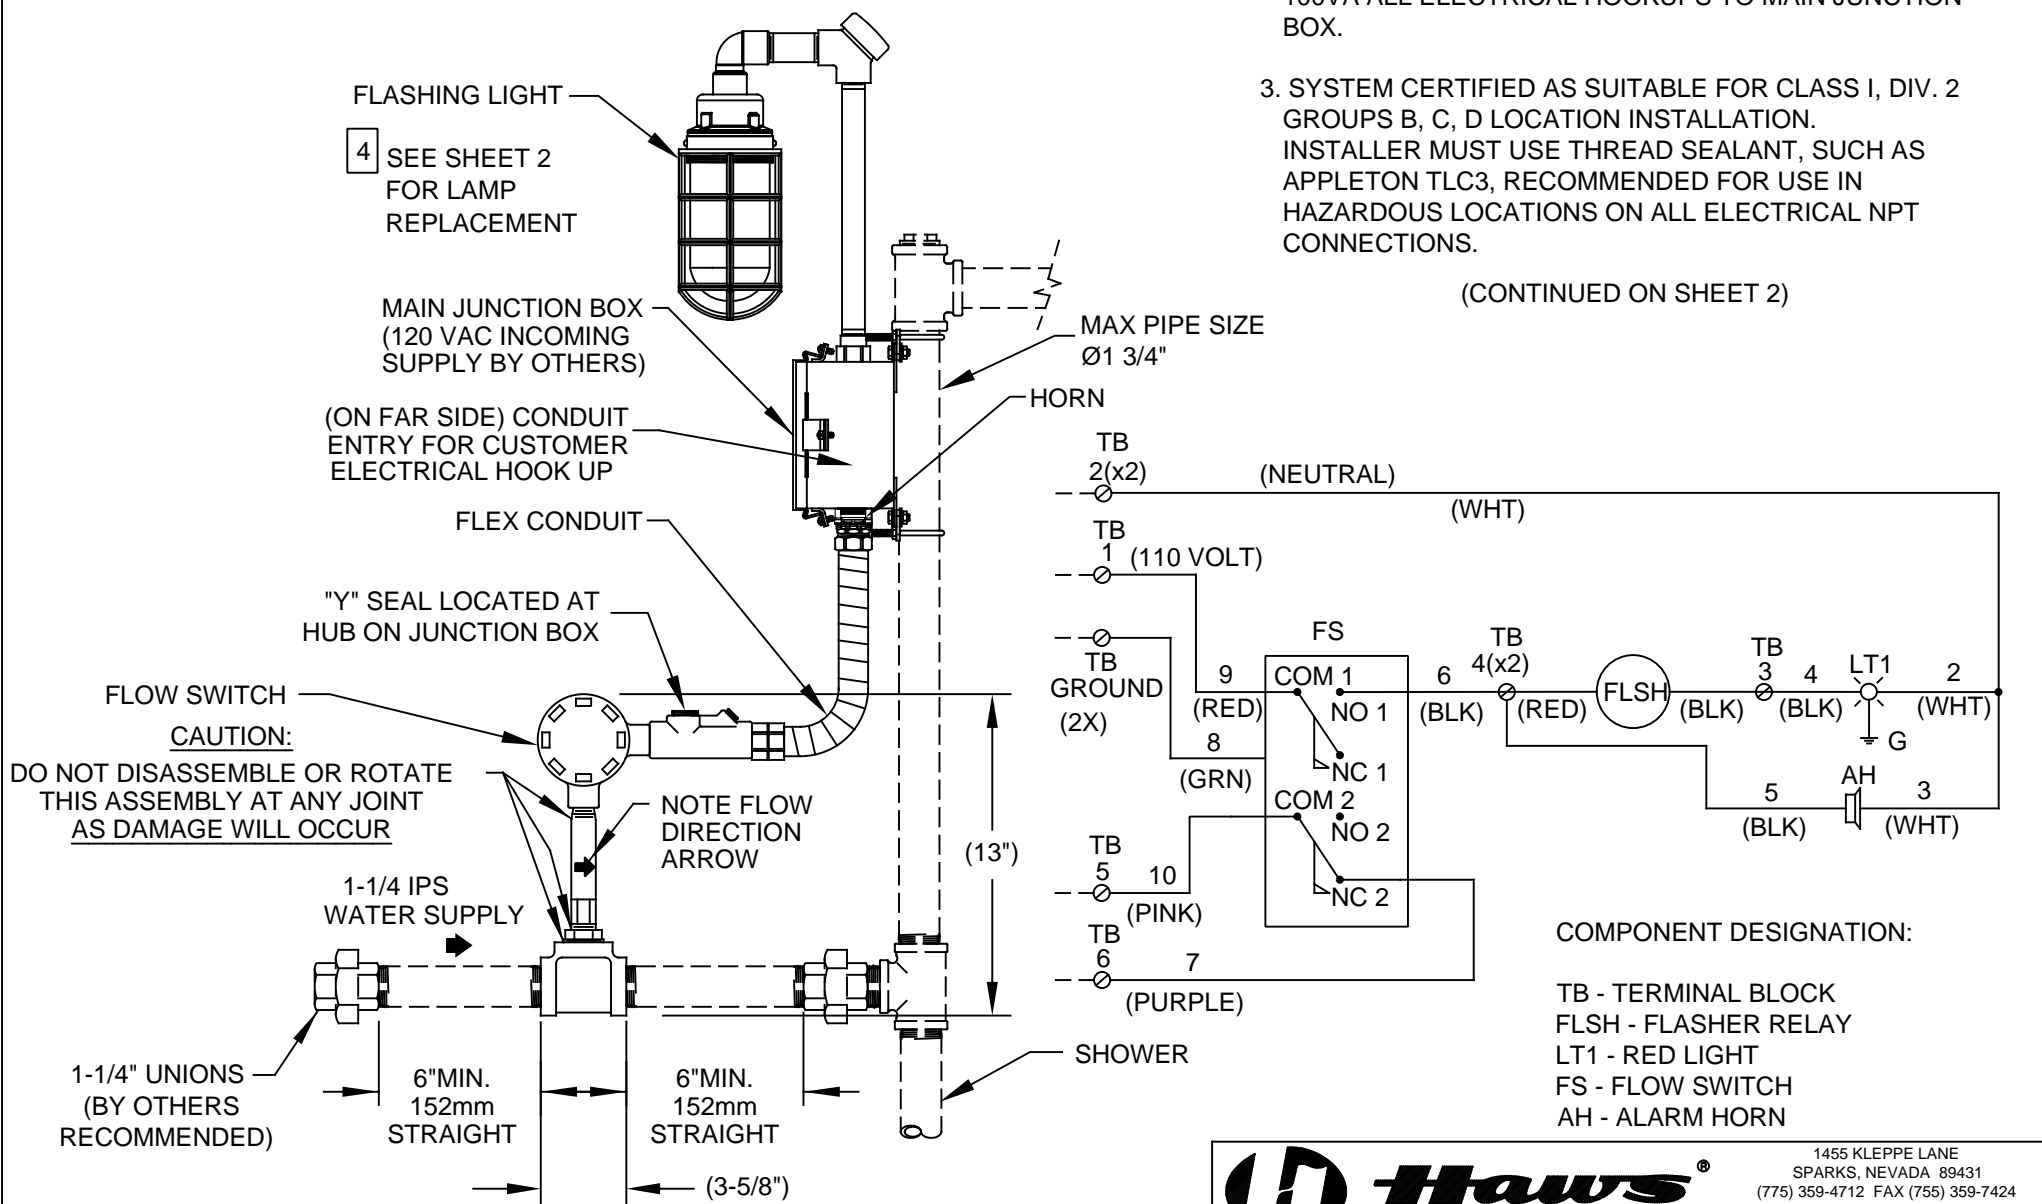


SWITCH MUST BE MOUNTED IN HORIZONTAL POSITION

				1455 KLEPPE LANE SPARKS, NEVADA 89431 (775) 359-4712 FAX (775) 359-7424 E-MAIL: HAWS@HAWS.CO.COM WEBSITE: WWW.HAWS.CO.COM			
ECN NO.	REVISED PER	BY:	DP	MODEL(S)	9001EXP		
DRAWN:	DATE:	CHK'D:					
APPROVED:	DATE:						
IR	12/09/19			SCALE: 1:1	DRAWING TYPE: INSTALLATION	SIZE: A	SHEET 1 OF 2
				PART NUMBER	0002080203.D		
				DRAWING NO.	09648A00		
				REV	25		

NOTES: (CONTINUED FROM SHEET 1)

4 LIGHT REPLACEMENT INSTRUCTIONS:

- 1) REMOVE GUARD AND GLOBE:
FIRST LOOSEN SET SCREW (LOCATED ON GUARD WHERE SHOWN). NEXT, ROTATE GUARD COUNTER CLOCKWISE UNTIL GUARD IS FREE. FINALLY ROTATE GLOBE COUNTER CLOCKWISE UNTIL GLOBE IS FREE AND LAMP IS EXPOSED.
- 2) ONLY REPLACE LAMP WITH HAWS P/N 0003225505.
WARNING - EXPLOSION HAZARD - SUBSTITUTION OF COMPONENTS MAY IMPAIR SUITABILITY FOR CLASS 1, DIVISION 2.
- 3) REPLACE GUARD AND GLOBE:
ROTATE GLOBE CLOCKWISE ONTO THREADS UNTIL SEALED AGAINST GASKET. NEXT, ROTATE GUARD CLOCKWISE ONTO THREADS UNTIL TIGHT. FINALLY TIGHTEN SET SCREW.

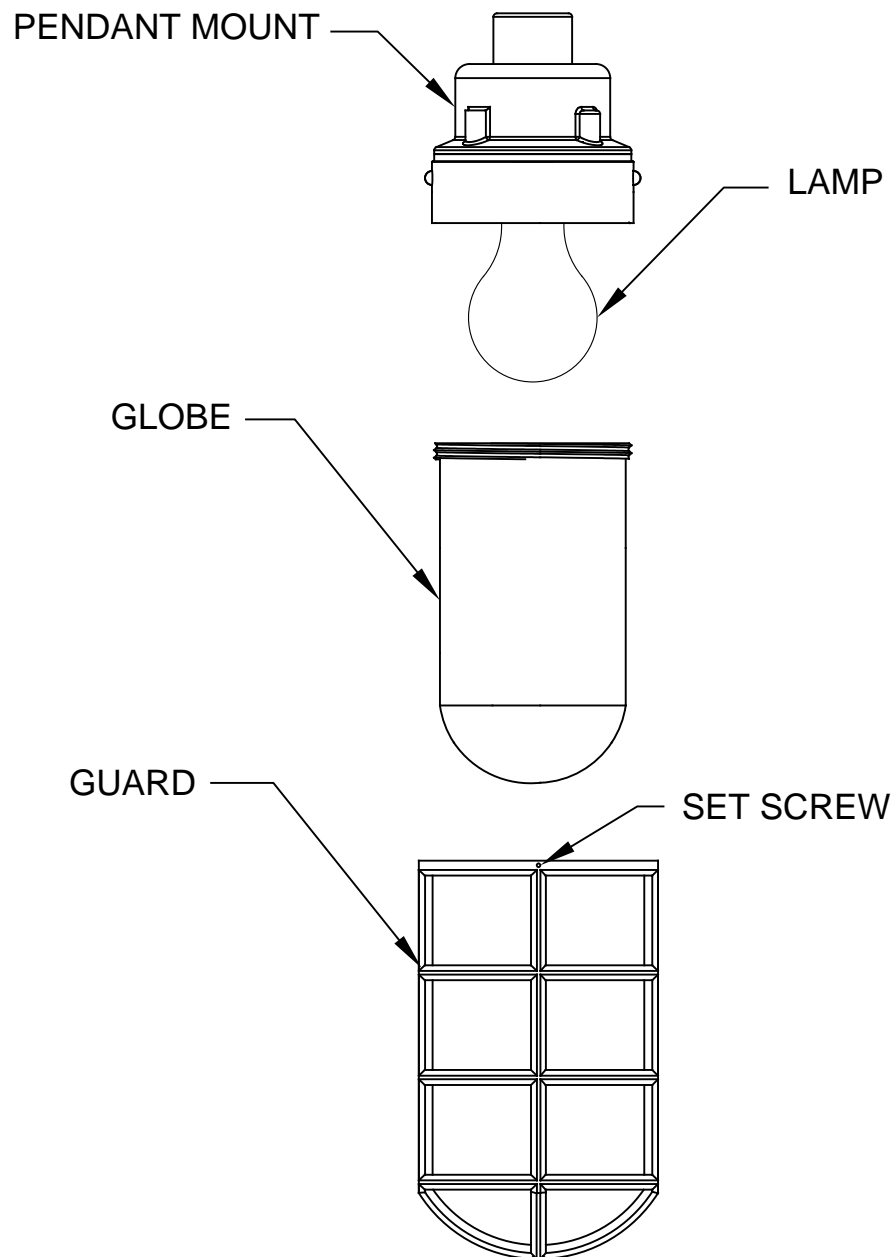

 Haws®		1455 KLEPPE LANE SPARKS, NEVADA 89431 (775) 359-4712 FAX (775) 359-7424 E-MAIL: HAWS@HAWS.CO.COM WEBSITE: WWW.HAWS.CO.COM	
		PART NUMBER 0002080203.D	
ECN NO.	REVISED PER	BY:	MODEL(S)
	ECN: 5438	DP	
DRAWN:	DATE:	CHK'D:	
HM	08/12/09		
APPROVED:	DATE:		
IR	12/09/19		
		SCALE: 1:1	DRAWING TYPE: INSTALLATION
		SIZE: A	SHEET 2 OF 2