


NOTES:


1. MODEL SP156 IS A HERMETICALLY-SEALED THERMOSTAT.
 - OPENS (RISING) AT 52°F (11.1°C).
 - CLOSSES (FALLING) AT 42°F (5.6°C).

REPLACEMENT INSTRUCTIONS:

1. REMOVE JUNCTION BOX ACCESS COVER.
2. DISCONNECT THERMOSTAT LEADS FROM TERMINAL BLOCK AND WIRE NUT.
3. UNTHREAD THERMOSTAT FROM MOUNTING PAD LOCATED INSIDE JUNCTION BOX.
4. THREAD NEW THERMOSTAT ONTO MOUNTING PAD.
5. CONNECT THERMOSTAT LEADS TO TERMINAL BLOCK AND WIRE NUT (SEE WIRING DIAGRAM).
6. REPLACE ACCESS COVER

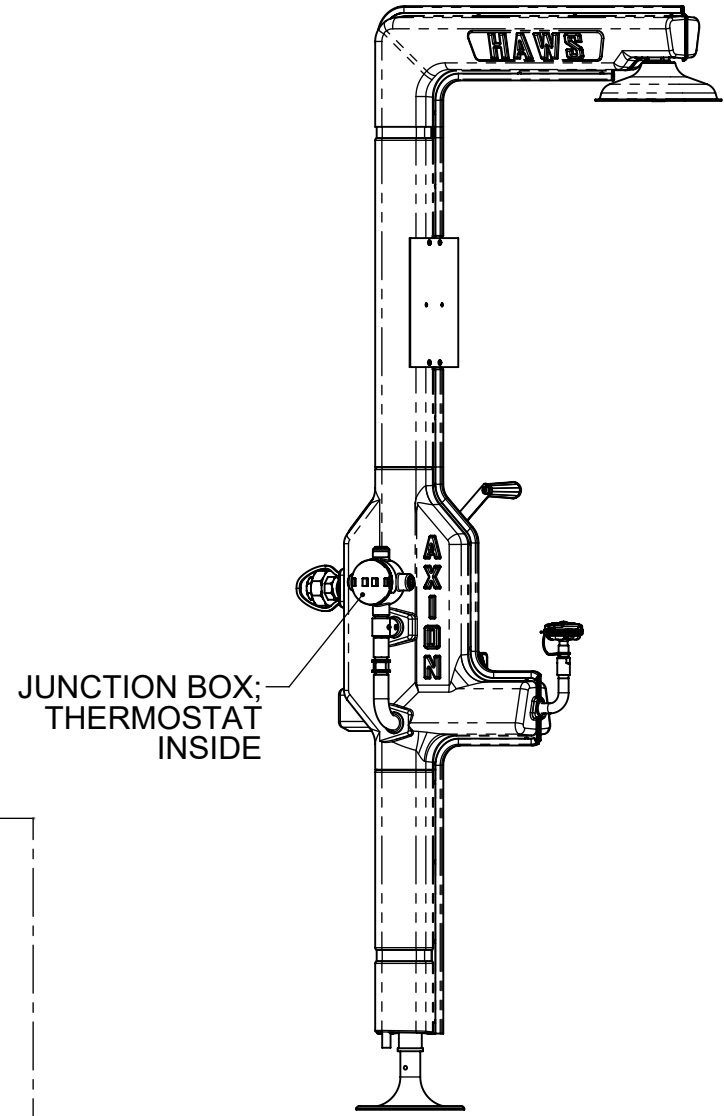

**8315CTFP SHOWER
(SOLD SEPARATELY)**

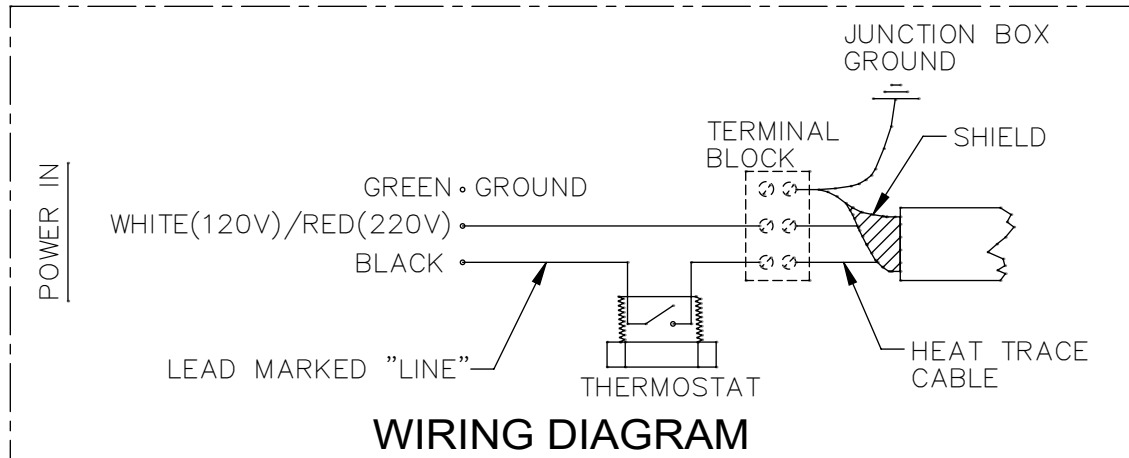

1455 KLEPPE LANE
SPARKS, NEVADA 89431
(775) 359-4712 FAX (775) 359-7424
E-MAIL: HAWS@HAWS.CO.COM
WEBSITE: WWW.HAWS.CO.COM

ECN: 5578	REV. ECN: 5578	BY:	MODEL(S) SP156 - THERMOSTAT	PART NUMBER 0510001073
DRAWN:	DATE:	CHKD: JL		REVISION 1
APPROVED: BJM	DATE: 09/18/20	SCALE: N/A	DRAWING TYPE: INSTALLATION	SIZE: A