
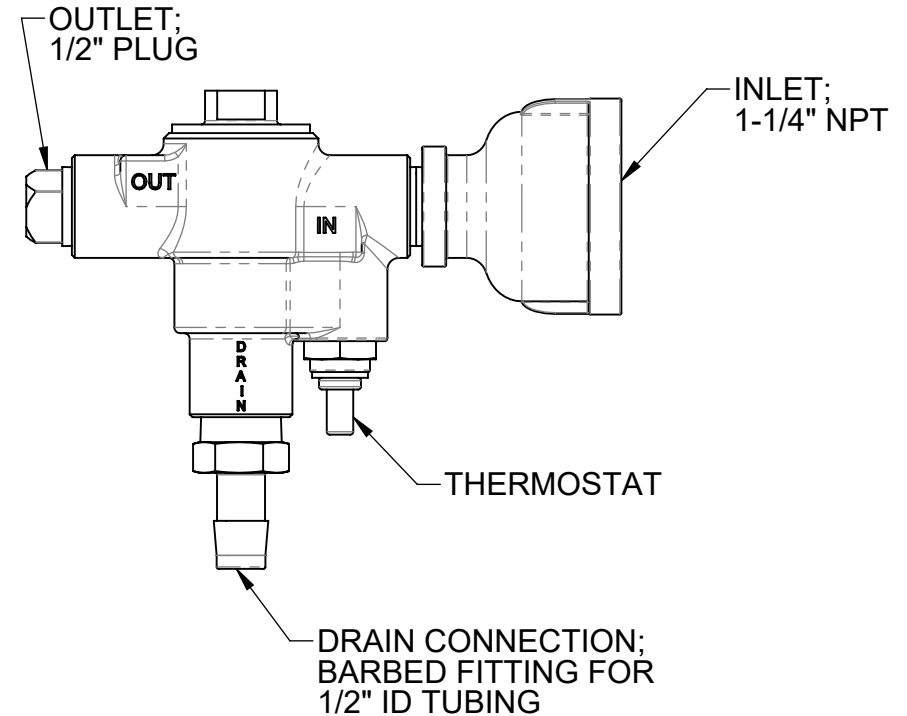


NOTES:

1. HOLD ROUGH-IN DIMENSIONS $\pm 1/4"$ (6.4mm).
2. WHEN INSTALLING THIS UNIT, LOCAL, STATE, OR FEDERAL CODES SHOULD BE ADHERED TO.

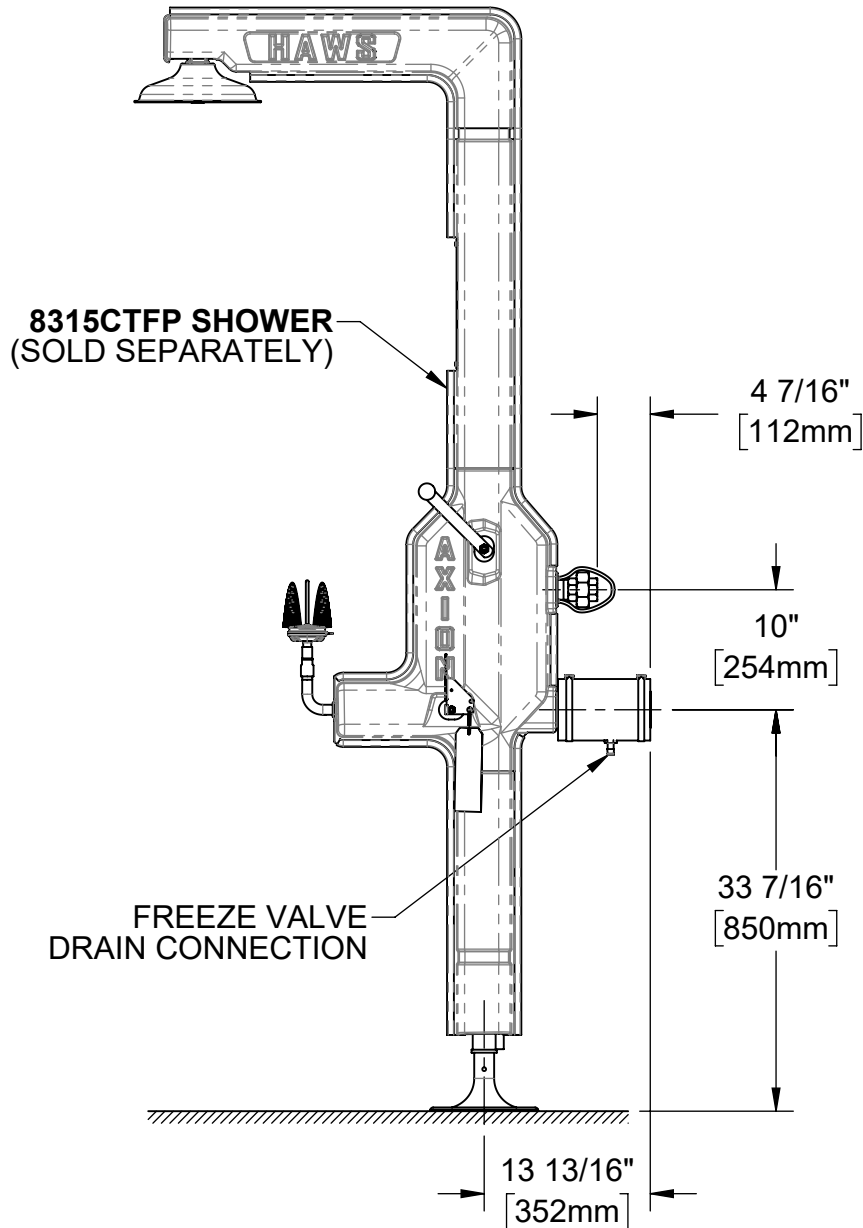

FACTORY-ASSEMBLED VALVE SECTION
(WITHOUT INSULATION, ZIP TIES, OR ADDITIONAL PLUMBING)

SP158.15 STANDALONE INSTALLATION
(FOR USE IN CONJUNCTION WITH THE SP121, CONSULT THE SP121 DOCUMENTATION)

				1455 KLEPPE LANE SPARKS, NEVADA 89431 (775) 359-4712 FAX (775) 359-7424 E-MAIL: HAWS@HAWSO.COM WEBSITE: WWW.HAWSO.COM			
ECN: 5588	REV. ECN: 5661	BY: JL	MODEL(S) SP158.15 FREEZE PROTECTION VALVE	PART NUMBER 0510001069.D			
DRAWN: JL	DATE: 09/17/20	CHKD: BJM		REVISION 2			
APPROVED: JL	DATE: 04/19/21	SCALE: N/A	DRAWING TYPE: INSTALLATION	SIZE: A	SHEET 1 OF 1		