



INSTALLATION, OPERATION & MAINTENANCE INSTRUCTIONS

1455 Kleppe Lane ♦ Sparks, NV 89431-6467 ♦ (775) 359-4712 ♦ Fax (775) 359-7424

E-mail: haws@hawsco.com ♦ Website: www.hawsco.com

No. 0580001081(2)

Model 8710

Outdoor Tempered Water Shower and Eyewash System

Area Classification – Ordinary



DISCLAIMER

IMPORTANT

Read this installation manual completely to ensure proper installation, then file it with the owner or maintenance department. Compliance and conformity to drain requirements and other local codes and ordinances is the responsibility of the installer.

Separate parts from packaging and make sure all parts are accounted for before discarding any packaging material. If any parts are missing, do not begin installation until you obtain the missing parts.

Flush the water supply lines before beginning installation and after installation is complete. Test the unit for leaks and adequate water flow. Main water supply to the emergency fixture should be "ON" at all times. Provisions shall be made to prevent unauthorized shutoff. Please refer to the enclosed instructions for flushing the unit prior to use.

The ANSI Z358.1 standard requires an uninterrupted supply of potable water. Water supply must be capable of providing specified capacity (GPM) and water pressure range (PSI) at all flow rates.

The inspection and testing results of this equipment should be recorded weekly to verify proper operation. This equipment should be inspected annually to ensure compliance with ANSI Z358.1.

Installation and maintenance of this system must be completed by a qualified plumber and electrician in accordance with the information contained in this installation manual and in compliance with all national and local codes. When making electrical connections, be sure to follow all lockout-tag out safety procedures.

It is recommended that all water supply and electrical connections be made at temperatures above freezing (32°F (0°C)). Failure to do so may result in product and or property damage.

For technical support, contact:

Haws Services | (800) 766-5612 | www.hawsco.com/solutions-services/services/

TABLE OF CONTENTS

DISCLAIMER	2
TABLE OF CONTENTS	3
DESCRIPTION OF PRODUCT	4
APPLICATION	4
SHIPPING, HANDLING AND STORAGE	5
INSTALLATION PROCEDURE	6
Checklist for start-up	9
PROGRAMMABLE CONTROLLER	10
PREVENTIVE MAINTENANCE	11
Weekly	11
Monthly	12
Quarterly	12
Annually	12
SYSTEM DRAIN AND CHECK PROCEDURE:	14
Booth	16
Double Swinging Doors	16
Blending Valve System	16
Combination Shower/Eyewash	16
Freeze and Scald Valve	17
Y-Strainers	17
TROUBLESHOOTING	18
SPARE PARTS	19
DRAWINGS	20
General Arrangement Drawing (0580001081.D-GA)	20
Electrical Schematic (0580001081.D-EL)	22
Piping and Instrumentation Diagram (0580001081.D-PID)	24
LIMITED WARRANTY	26

DESCRIPTION OF PRODUCT

Haws Corporation Model 8710 Tempered Water Shower Booth is a foam-insulated, aluminum skinned enclosure with high visibility green chemical and UV resistant polyester-based powder coating. Large graphics identify the building as an emergency shower/eyewash station and assist in guiding the user to the double swing doors. The interior is illuminated green during standby and changes to white light when someone enters the doors, or the shower or eyewash is activated. Optional space heating is available for user safety and comfort and equipment protection.

Hot water generated via an immersion heater is stored in the water tank. Hot and cold water are mixed with an engineered blending system to provide tepid water for the specified number of combination shower/eyewash operations. Typical flow rate of a combination shower/eyewash is 30 GPM. The ASSE 1071 certified blending system is a safe, prepackaged, fully engineered and tested system for blending large volumes of hot and cold water specifically designed for emergency showers and eyewashes. The system provides multiple levels of protection to prevent scalding, including a high temperature shutoff valve. Also included is a pressure relief cold-water bypass that allows full cold flow in the event of a hot water shut off. There are no electrical components in the blending system.

The 8710 booth includes a Haws® combination shower and eyewash that is protected with a scald valve. Optional alarms are activated by a flow switch when the shower and/or eyewash are in use. Dry contacts can be provided for remote alarm notification and/or both visual and audible alarms with a silencing circuit that auto resets can be provided.

APPLICATION

Tank temperatures are set at 165°F for USA and 145°F for Canada.

TANK SIZE	TANK TEMPERATURE	SHOWER CAPACITY (15 Min.)	MINIMUM INLET TEMPERATURE
119G	145°F	1	62°F
	165°F	1	54°F
120G	145°F	1	62°F
	165°F	1	54°F
200G	145°F	1	35°F
	165°F	1	32°F
318G	145°F	2	50°F
	165°F	2	39°F
400G	145°F	2	35°F
	165°F	2	32°F

SHIPPING, HANDLING AND STORAGE

Model	Description	Dimensions W x L x H	Weight	Dimensions W x L x H (Crated)	Weight (Crated)
8710	Outdoor Tempered Water Shower and Eyewash System	60" x 120" x 102"	< 4000 lbs.	69" x 134" x 106"	< 5000 lbs.

Recommended Equipment, Materials and Supplies to be provided by Installer:

- Concrete slab rated to support a minimum of 8,000-pound load requirement.
- (4) 3/4" minimum diameter by 1-1/2" minimum length anchor bolts with washers.
- A forklift capable of lifting 5,000 lbs. should be utilized to transport the unit from truck to site. The unit should be lifted from the rear, or equipment end, and low to the ground.
- Electrical Supply Materials (if applicable).
- Plumbing Supply Materials (if applicable).
- Freeze protection equipment for the water supply leading up to the enclosure (if applicable).

Storage

The unit should be stored in a clean, dry place until ready for installation unless otherwise specified.

INSTALLATION PROCEDURE

WARNING: DO NOT connect power before supply plumbing. Connections should be performed by a certified electrician and plumber only.

- a. Remove unit from crate.
- b. The unit should be secured on a level site, using the supplied brackets and suitable anchoring devices. Suggested anchoring devices are 3/4" minimum diameter by 1-1/2" minimum length anchor bolts with washers.
- c. If the booth is to be placed over a drain, the drain should be able to handle a flow of 35 GPM; otherwise, the slab should be made to allow the water to drain out the sides and away from the booth (see Figure 1). The unit discharges hundreds of gallons of water, which can cause significant property damage and a potential hazard if not drained properly.

WARNING: Drainage means shall not create an obstruction or tripping hazard.

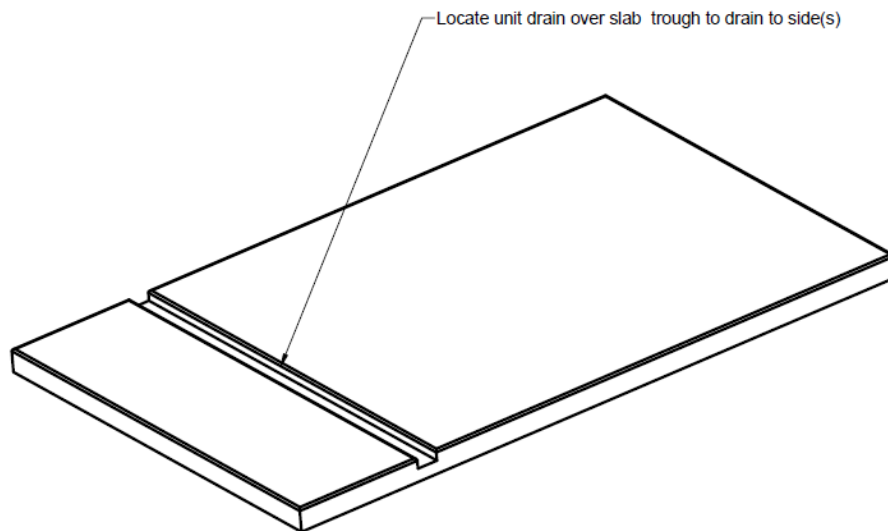


Figure 1. Example of Slab with Drain Trough

WARNING: Failure to allow water to drain may result in premature failure of booth, voiding of product warranty, property damage, and hazard to personnel. (See System Drain and Check Procedure)

- d. The connection provided for the water supply is a 1-1/2" NPT union. Water supply lines are required to be capable of supplying the required pressure and flow to meet ANSI Z358.1. The water supply line should run for a few minutes prior to connection to eliminate any debris before it enters the equipment.
- e. Connect electrical supply to the Power Disconnect Switch (see Figure 2).

NOTICE: All Power Connections must be made according to local codes and standards using components which are compliant with the area the unit is being installed in.



Figure 2. Disconnect Switch Junction Box

CAUTION: Do not apply power to the unit until all water connections are made and the tank and piping are full of water.

- f. Once all water and power connections are made, open the supply water inlet valve, and fill the system. While water is flowing into the system, open the emergency shower to facilitate air removal from the system. After water flows freely from the shower for several minutes, turn the shower off. Inspect plumbing for leaks and repair as necessary. During transit, some plumbing may have become loose, allowing water to leak from the threads.
- g. The expansion tank should be charged with compressed air to a pressure equal to the water supply pressure. An air fitting (Schrader valve) is accessible on the top of the expansion tank, under the plastic cap (see Figure 3).



Figure 3. Top of Expansion Tank

CAUTION: Before turning on the power, close all electrical boxes.

- h. At this point the power can be turned on. The tank water must be allowed to heat up before the blending system will function properly. Heating can take up to 12 hours, depending on supply water temperature and the size of immersion heater and tank.

NOTE: The emergency shower or eyewash (see Figure 4) should be utilized for testing of the blending system. Refer to the Maintenance, Testing, and Repair section of the TWBS.HF Blending System Manual document for proper adjustment and operation.



Figure 4. Eyewash

- i. The optional internal space heater has an adjustable thermostat, which is factory set at 70°F (21°C).

WARNING: System is not freeze protected without an energized electrical connection. It is recommended that installation be completed when ambient temperature is above freezing.

Checklist for start-up

CHECKLIST	Complete OK	Inspector Initials
Pre-connection Check		
Check all components for any connections or connectors that may have loosened during shipping.		
System Flush (All Electrical Power off for System Flush)		
Verify that the required water supply pressure is available at the Cold-Water Inlet.		
Drain is attached and able to handle a flow of 35 GPM.		
Water is clear and free of any contamination, particles, or discoloration.		
Connections		
System is charged with water and all air is evacuated from the system.		
Expansion tank Schrader valve is charged with air equal to water static inlet pressure.		
Connect remote monitoring via plant control system (if applicable).		
Applying Power to the System		
Verify that the proper voltage is present.		
Verify that equipment ground is properly connected.		
Apply power to the system.		
Verify that the space heater thermostat is set to 70° F (21°C) (if applicable). Increase the thermostat set point and verify that the heater is producing heat. Return the thermostat to 70°F.		
Verify that the tank heater thermostat is set to 165° F (74°C) for US applications and 145°F (63°C) for Canada applications. Increase the thermostat set point and verify that the heater is producing heat. Return the thermostat to original setpoint.		
Verify that interior and exterior lights are illuminated (if equipped).		
HAWS® Shower and Eye/Facewash		
Flow water through an eyewash or shower.		
Verify that the exterior light flashes at 1 second intervals and that the audible alarm sounds (if equipped).		
Press the alarm silence button and verify that the exterior light is flashing, and the audible alarm is silent (if equipped).		
Deactivate the shower or eyewash that is active, verify that the exterior light is not flashing, and that the audible alarm is silent (if equipped).		
Blending Valve		
When shower is activated read the center temperature gauge directly above the blending valve to ensure the readout is 84°F (29°C) ± 5°.		

PROGRAMMABLE CONTROLLER

The programmable controller executes the following functions:

- Deactivates the tank heater when the tank level is low.
- Switches the alarm light from steady to flashing when eyewash/shower is in use.
- Opens dry contacts for Common alarm when tank level is low.
- Opens dry contact for In Use alarm when eyewash/shower is in use.
- Changes interior light from green to white when doors are opened.

The following table lists the inputs and outputs available with the system. System may not contain all components.

Input	Function		Output	Function
I-01	Horn Silence Button		Q-01	Tank Heater Contactor
I-02	Flow Switch or Proximity Switch		Q-02	Area/ Alarm Light
I-03	Proximity Switch		Q-03	Alarm Horn
I-04	Level Switch		Q-01 (Exp. Mod.)	Customer Contact (Common)
I-05	Door Proximity Switch		Q-02 (Exp. Mod.)	Customer Contact (In Use)
I-06	Tank Temperature Switch		Q-03 (Exp. Mod.)	Interior Light (Green/White)

NOTE: For model specific program, please contact Haws Services at 1-800-766-5612.

PREVENTIVE MAINTENANCE

Note: These are general instructions applicable to all Haws Model 8710 Tempered Shower Booths.
Additional maintenance activities may apply to particular configurations/options supplied.

Weekly

- Verify the tank temperature gauge reads $165^{\circ}\text{F} \pm 2^{\circ}\text{F}$ ($74^{\circ}\text{C} \pm 1^{\circ}\text{C}$) and $145^{\circ}\text{F} \pm 2^{\circ}\text{F}$ ($63^{\circ}\text{C} \pm 1^{\circ}\text{C}$) for Canada.
- Verify area lights located inside and outside the booth are operational.
- Verify space heater is functioning by raising space heater thermostat to a set point above the ambient temperature. Thermostat is mounted on the space heater. After several minutes the space heater should begin to emit heat. Return space heater thermostat to 70°F (21°C).
- Verify shower and eyewash flow per ANSI requirements.
- Verify temperature gauge on center pipe of blending valve (see Figure 5) reads $84^{\circ}\text{F} \pm 5^{\circ}\text{F}$ ($29^{\circ}\text{C} \pm 2^{\circ}\text{C}$) flowing.



Figure 5. Blending Valve

Monthly

- Verify eyewash flows. Optional Alarm light and horn should activate when water is flowing. Verify that remote alarms connected to plant controls are functioning.
- Verify shower flow. Optional Alarm light and horn should activate when water is flowing. Verify that remote alarms connected to plant controls are functioning.
- Check for evidence of leakage on freeze and scald valves.
- Verify correct operation of Blending valve. See Maintenance, Testing, and Repair section.

Quarterly

- Flush Y-strainers

Annually

- Check tank heater for excessive mineral build up on heating coils. Clean or replace if necessary.
- Check condition of tank anode(s). Replace if necessary.
- Drain tank and verify level switch operation (see Figure 6).



Figure 6. Level Switch

- All emergency showers and eye/face washes shall be inspected annually to assure conformance of ANSI Z358.1. This includes, but not limited to, proper installation, accessible locations, proper flow rate and temperature of flushing fluid. Please refer to the most current standards document for more information.

NOTE: If the blending valve temperature reading is incorrect, adjust the blending valve by turning the socket head cap screw located on the bottom of the center section of the valve body. Turning the screw clockwise will lower the outlet temperature, while counterclockwise will raise the outlet temperature (see Figure 7). Maximum outlet temperature is approximately 84°F. Outlet temperature will be measured most accurately by the temperature gauge when water is flowing through the valve.

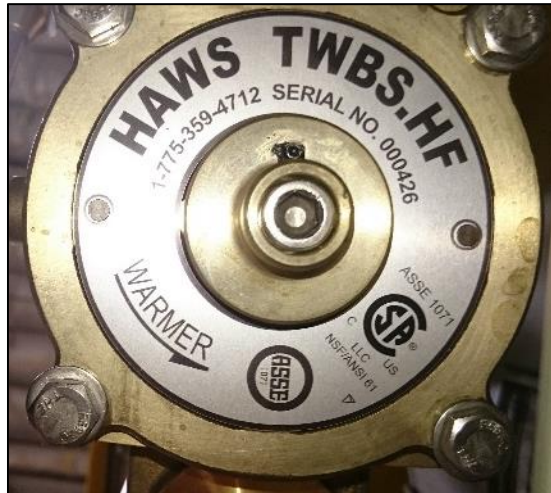


Figure 7. Blending Valve

SYSTEM DRAIN AND CHECK PROCEDURE:

WARNING! System contains HOT water! Failure to DISCONNECT POWER AND ALLOW WATER IN HOT WATER TANK TO COOL sufficiently prior to draining may cause SEVERE INJURY OR DEATH! Always follow safe Lock Out – Tag Out procedures.

1. Turn off power at system disconnect switch. Lock Out and Tag Out according to your company's procedures.
2. Allow system hot water tank to cool below 100°F. Cooling could take many hours depending on the ambient temperature. This process can be sped up by opening the shower and allowing the blending valve to consume the hot water from the tank in the blending process. While the shower is running, monitor the blending valve hot water inlet mechanical temperature gauge. When the blending valve hot water inlet temperature gauge drops below 100°F WHILE FLOWING, the tank temperature will be low enough to facilitate safe system draining.
 - a. If you will be running the shower to drop the tank temperature, this may be an appropriate opportunity to also perform an annual test of the shower for ANSI Z358.1 compliance for flow and pattern.
3. When the hot water tank has cooled sufficiently, shut off the shower if it has been activated, and turn off the main inlet water supply ball valve located inside the booth on the water supply line. This is a lockable ball valve and Haws recommends locking this valve in the off position any time the system is to be drained.
4. If necessary, connect a drain hose to the drain elbow outside the booth and route to a safe drain location (or to the shower drain if unit is connected to a drainpipe). Do not open drain valve until step 8.
5. Confirm that the power is disconnected.
6. Unscrew and remove the cover on the Level Switch.
7. Using a multimeter, check continuity across the wired terminal block between the pin labeled "C" and the pin labeled "NC". If the tank is full, as it should be at this point, the multimeter should indicate electrical continuity exists between these two pins. (Note this Double Pole, Double Throw switch has two identical terminal blocks and testing should be done on the one that is wired.) If the tank has been heating properly, this test SHOULD be positive. If not, check the connections and confirm the tank is full.

8. To safely drain tank, relieve system pressure by opening shower then open the ball valve on the y-strainer in the hot water line located between the top of the tank and the hot side of the blending valve. Opening this valve allows air to enter the system when draining. Open the system drain valve inside the booth near the drain outlet elbow in the back wall to drain the system. Continue until water stops draining.
9. Using a multimeter, check continuity across the wired terminal block between the pin labeled "C" and the pin labeled "NC". If the tank is empty (or below the level of the switch), as it should be at this point, the multimeter should indicate NO electrical continuity exists between these two pins. (Note this Double Pole, Double Throw switch has two identical terminal blocks and testing should be done on the one that is wired.) If the multimeter indicates continuity DOES exist when the tank is empty, the float may be stuck in the up position, which would require removal and cleaning and/or replacement of the level switch.
10. Remove and inspect the tank "sacrificial" anode rod(s) for condition. These rods are designed to corrode and deteriorate before other less reactive surfaces in the system, so some corrosion is normal. If the stainless-steel core can be seen or the rod is grossly deteriorated, it should be replaced.
11. Remove and inspect the tank heater for excessive mineral buildup on the heater coils. In particular, if significant debris is noticed in the drain water, the local water is known to be "hard" or have high mineral content, or tank heater monitoring indicates more and more frequent cycling, consider removing and inspecting/cleaning the immersion heater. (Electrical disconnection and re-connection should be done by a qualified electrician) Contact Haws Services for questions at 1-800-766-5612.
12. Open and clean out the Y-strainers (one in the inlet water line and one in the hot water line).
13. When maintenance is complete and any components removed have been replaced, close the system drain valve and the ball valve on the hot line Y-strainer if it was opened.
14. Unlock and open the inlet water supply valve and allow the system to fill. Opening the shower can facilitate purging of air from the system.
15. When the system is full of water, follow appropriate Lock Out, Tag Out procedures to unlock and turn on the system disconnect switch to restore power to the unit.
16. Allow time for the system to come up to temperature (up to 24 hours) and ensure that all alarms are clear.

MAINTENANCE, TESTING, REPAIR

Booth

The booth is made of aluminum skins laminated to an insulating foam core then powder coated. Should cleaning be necessary, a mixture of water with household glass cleaner or rubbing alcohol can be used. For repairs to small holes in the booth, Sikaflex 1A Construction Sealant, silicone, or a similar sealant can be used to seal openings in the booth's surface.

WARNING: Failure to patch or fill any holes or punctures to booth may result in premature failure of booth and void the product warranty.

Double Swinging Doors

CAUTION: KEEP FINGERS AWAY FROM PINCH POINTS!

The doors have been adjusted at the factory with proper tension to allow for closure of doors. Should doors need to be adjusted, tension can be changed by adjusting the spring tensioner at the top or bottom of the spring loaded double acting hinges.

Blending Valve System

The TWBS.HF blending valve system (see Figure 8) should require minimal amount of maintenance. During scheduled testing, the temperature output should be checked for proper adjustment. With the shower or eye/facewash activated the outlet temperature should be approximately 80-85°F.



Figure 8. Blending Valve

NOTE: For more information, refer to TWBS.HF the Blending Valve System O&M manual.

Combination Shower/Eyewash

Verify shower and eyewash flow per ANSI requirements.

NOTE: If shower and/or eyewash does not flow per ANSI requirements or at all, consult Haws Services.

Freeze and Scald Valve

Scald valve is designed to open before internal water temperature exceeds 100°F (37.8°C).

Freeze is designed to open before internal water temperature drops below 35°F (1.7°C).

NOTE: If valve does not fully open/close, check valve seat for debris or scale build up. If no debris or scale is present, consult Haws Services at 1-800-766-5612.

CAUTION: Extreme hot/cold temperatures in booth may cause valves to open.

Y-Strainers

Y-strainers should be blown out at the same time as scheduled testing of showers or monthly.

For technical support, contact:

Haws Services | (800) 766-5612 | www.hawsco.com/services

TROUBLESHOOTING

TROUBLE	REPAIR CHECKLIST
Tank temperature too cold (165°F (74°C) for standard or 145°F (63°C) for Canada):	a) Used recently? Full recovery could take 24 hours. b) Check thermostat setting (165°F/145°F). c) Check tank heater circuit fuses F1. d) Check control voltage and power supply fuses PFU & CFU.
Tank temperature too hot:	a) Check thermostat setting.
Space heater not on when temperature is below 70°F (21°C):	a) Check thermostat setting. b) Check heater fuses F2 and F3 (if applicable).
Uneven water flow to eyewash:	a) Eyewash must be level. b) Clogged flow control. Clean or replace flow control in eyewash head.
Insufficient water flow to eyewash or shower:	a) Check water supply dynamic pressure (45-90 PSI). b) Check and clean "Y" strainers. c) Check ball valves. Must be open and unclogged. d) Clogged flow control. Clean or replace flow control in either eyewash or shower.
Clear exterior light off:	a) Check LED. b) Check fuses PFU & CFU.
Exterior light does not flash, and alarm does not sound when shower or eyewash is activated:	a) Check flow switch or proximity switch actuation. b) Check flow switch or proximity switch wiring.
Exterior alarm does not flash, but alarm is sounding when shower or eyewash is activated:	a) Check LED. b) Check wiring to light.

If there are any questions that cannot be answered here, please consult:

Haws Services | (800) 766-5612 | www.hawsco.com/services







SPARE PARTS

Please call Haws Services to order spare parts: 1-800-766-5612

NOTES:


1. DIMENSIONS IN INCHES
2. ALL TOLERANCES: $\pm 1/2"$
3. ESTIMATED WEIGHT (119G TANK):
 DRY: 3250 LBS
 WET: 6700 LBS
5. AREA CLASSIFICATION: ORDINARY
6. AVAILABLE AMBIENT TEMPERATURE RANGES:
 -50°F - 104°F, -30°F - 104°F, 32°F - 104°F, 32°F - 120°F
7. RATINGS: CONFIGURABLE WITH TYPE 4/4X JUNCTION BOX FOR INDOOR OR OUTDOOR LOCATION
8. NOT ALL FEATURES ARE STANDARD


REVISIONS				
REV	DESCRIPTION	ECN	DATE	BY
1	INITIAL RELEASE	5589	9/16/20	IR
2	PER ECO	5624	11/19/2021	IR

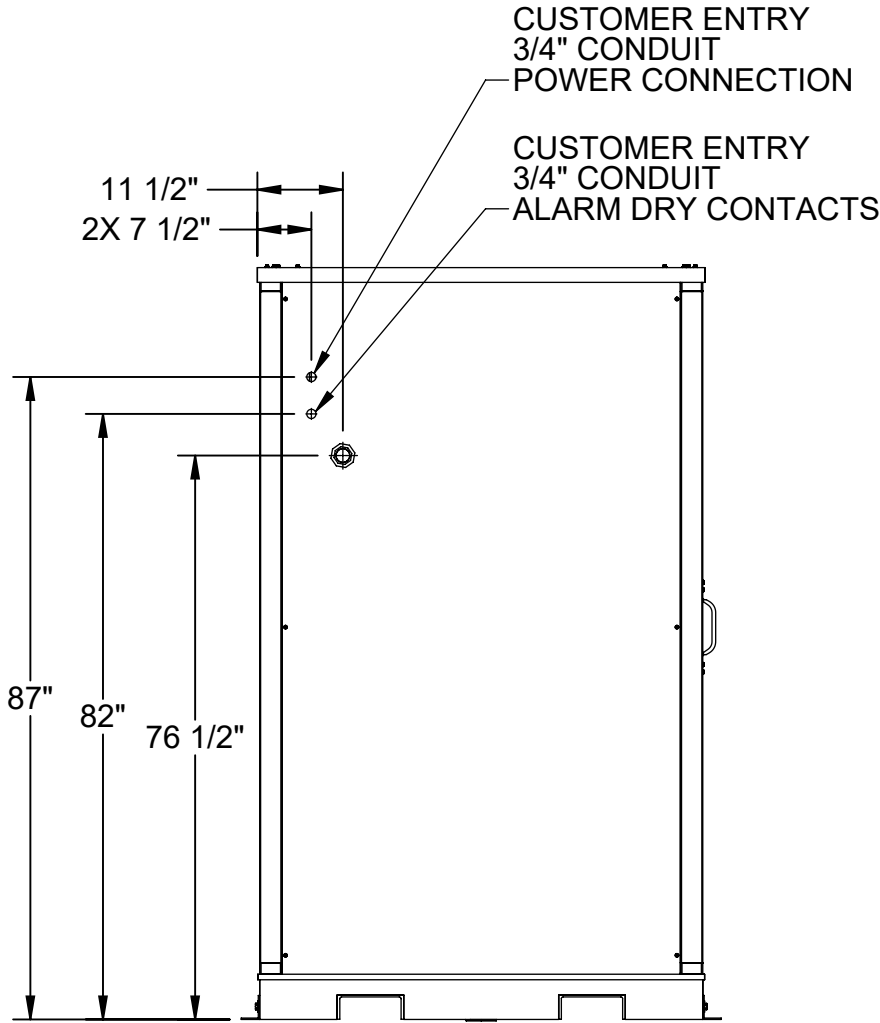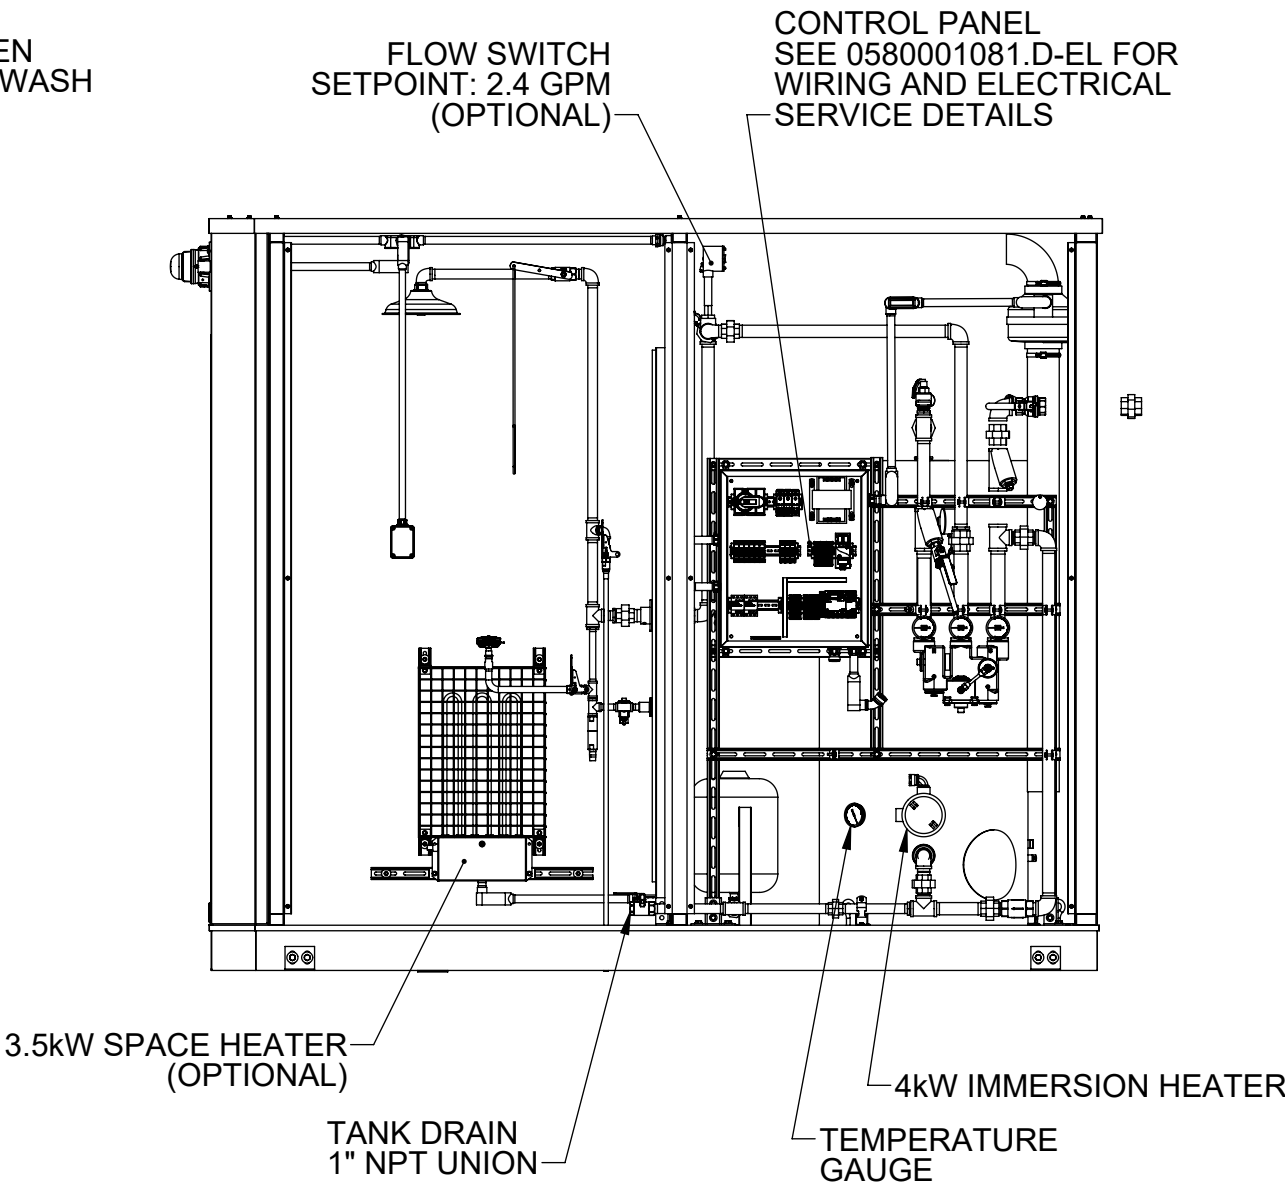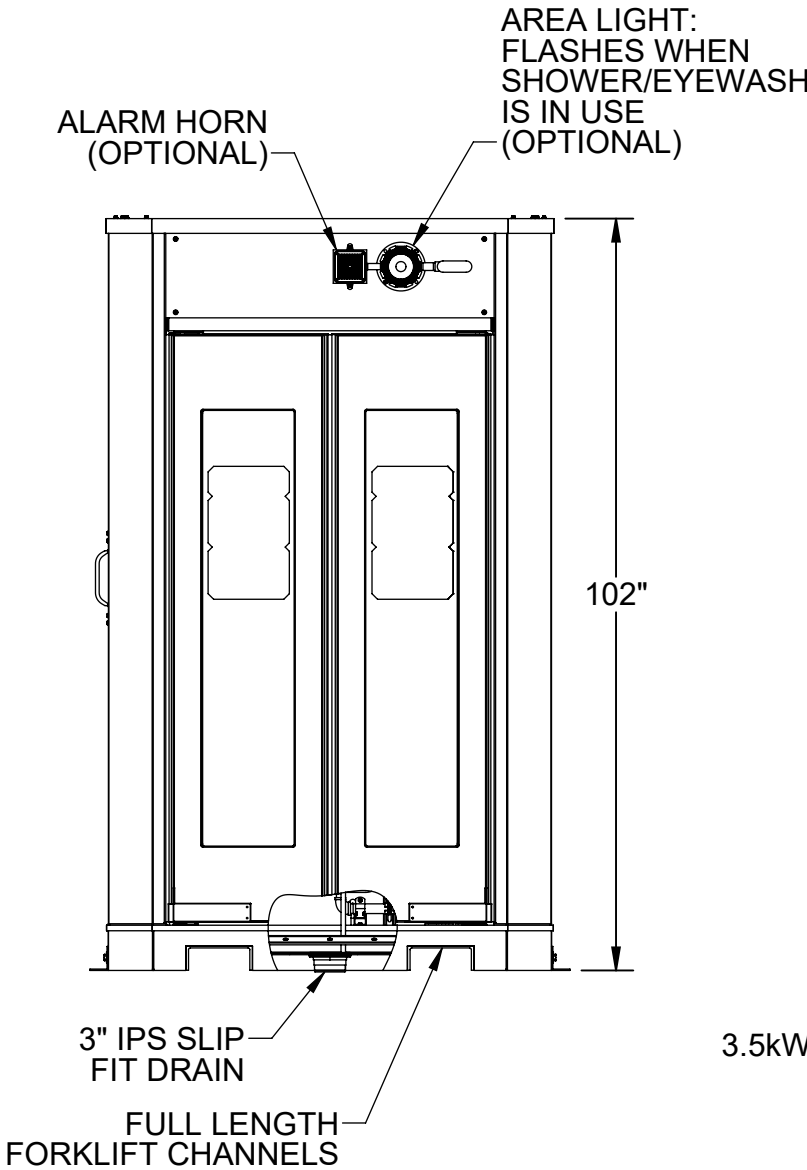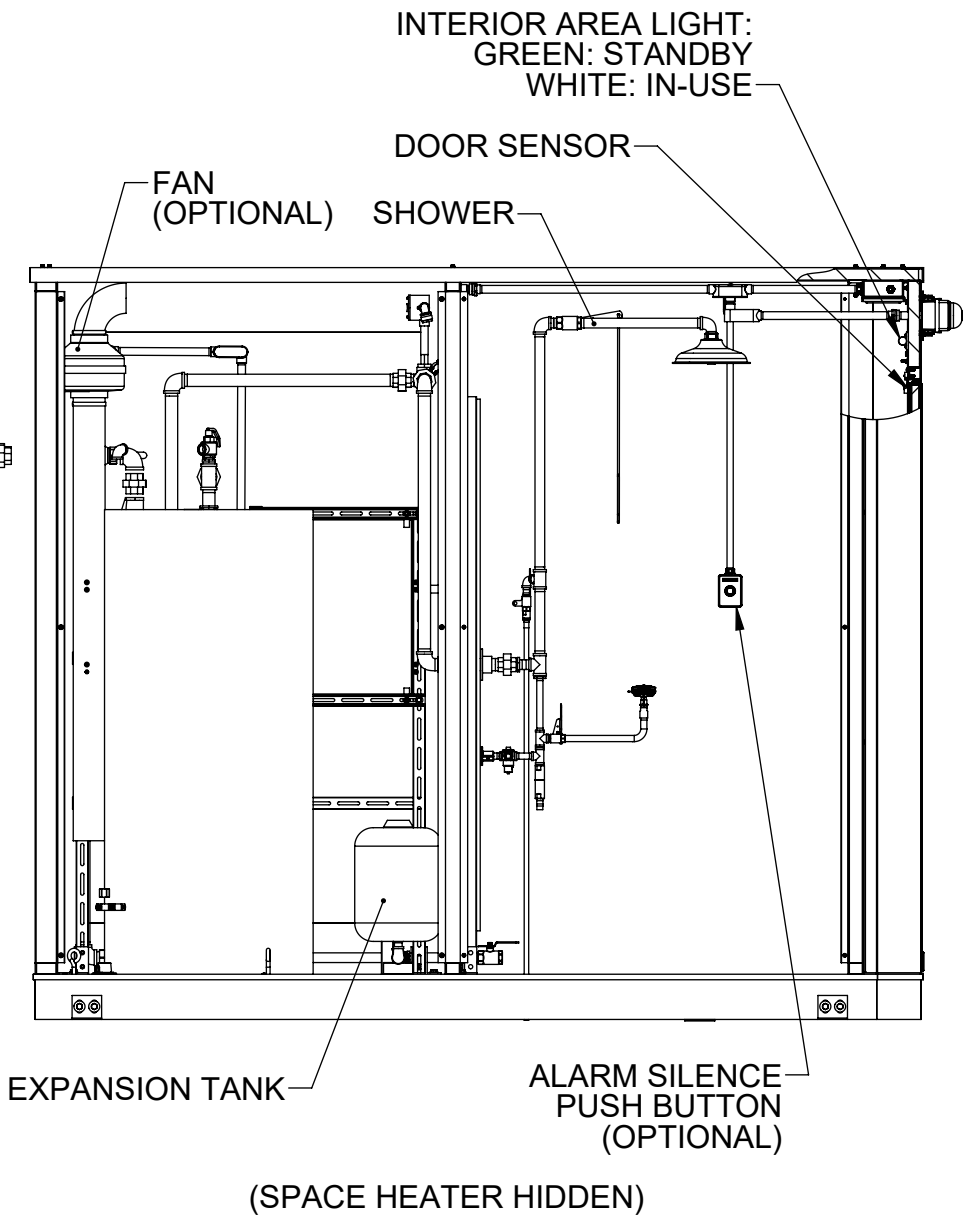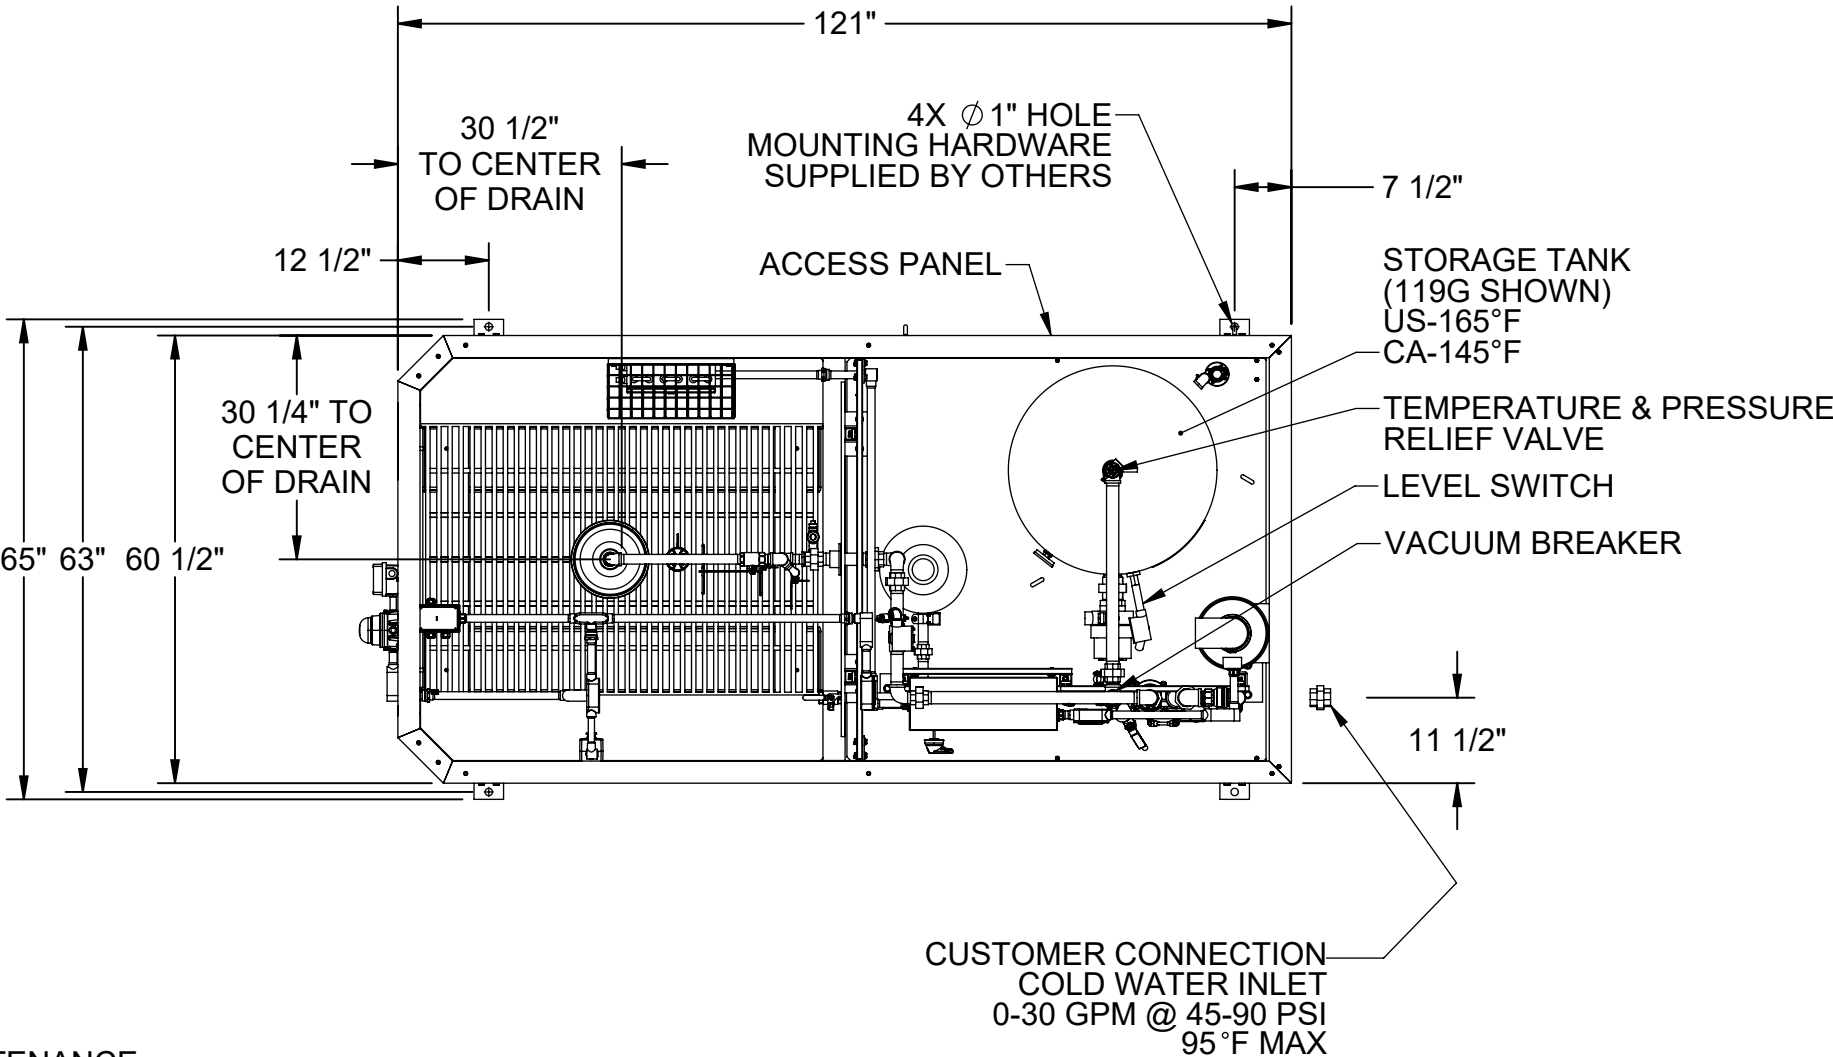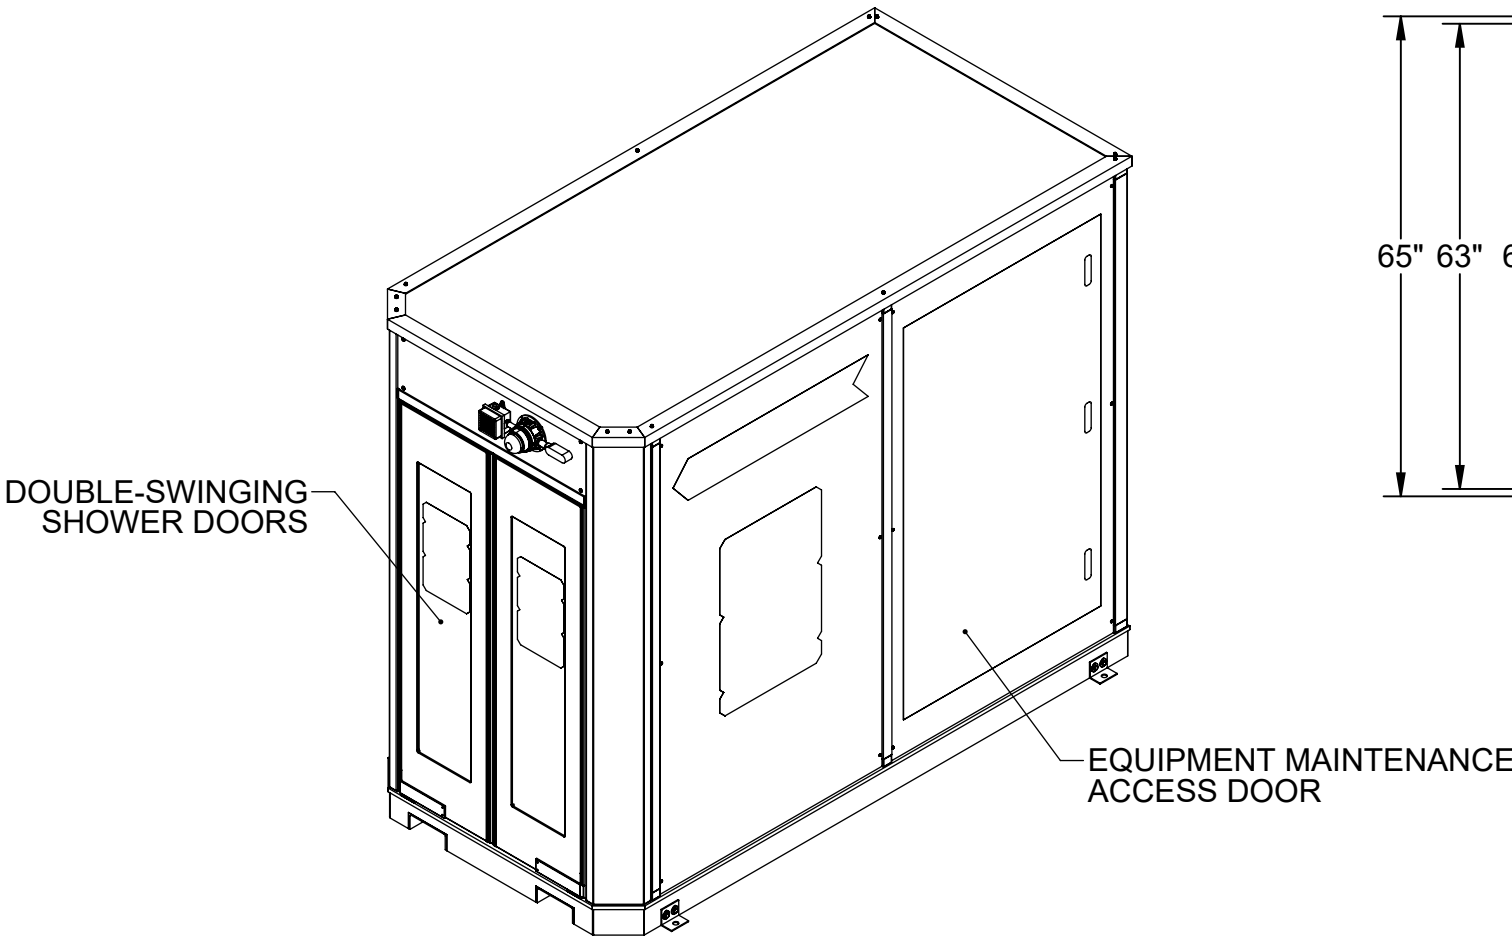


PANELS REMOVED FOR CLARITY

THE ATTACHED DESIGNS ARE CONSIDERED TRADE SECRETS AND POTENTIALLY PATENTABLE. IN ACCORDANCE WITH CONFIDENTIALITY AND NON-DISCLOSURE AGREEMENT, THESE DESIGNS IN ACTUAL OR CONCEPTUAL FORMS CANNOT BE DISCLOSED, REPRODUCED OR USED WITHOUT HAWS' EXPRESS WRITTEN CONSENT.

CUSTOMER INFO/TAG #:		 1455 KLEPPE LANE SPARKS, NEVADA 89431 USA	
JOB NUMBER:		TITLE OUTDOOR TEMPERED SHOWER AND EYE/FACE WASH SYSTEM	
DRAWN BY:	DP	<small>NOTICE OF PROPRIETARY INFORMATION</small> INFORMATION CONTAINED HEREIN IS THE SOLE PROPERTY OF HAWS CORPORATION AND THIS DOCUMENT AND THE DATA DISCLOSED HEREIN OR HEREWITH IS NOT TO BE REPRODUCED, USED, OR DISCLOSED IN WHOLE OR IN PART TO ANYONE WITHOUT THE PERMISSION OF HAWS CORPORATION. <div>GA SH 1 OF 1</div>	
DRAWN DATE:	07/14/21		
CHECKED BY:	AM		
CHECKED DATE:	11/23/21		
APPROVED BY:	IR	SCALE	SIZE PART NO.
APPROVAL DATE:	11/30/21	1:32	C 0580001081.D-GA
			REV. 2

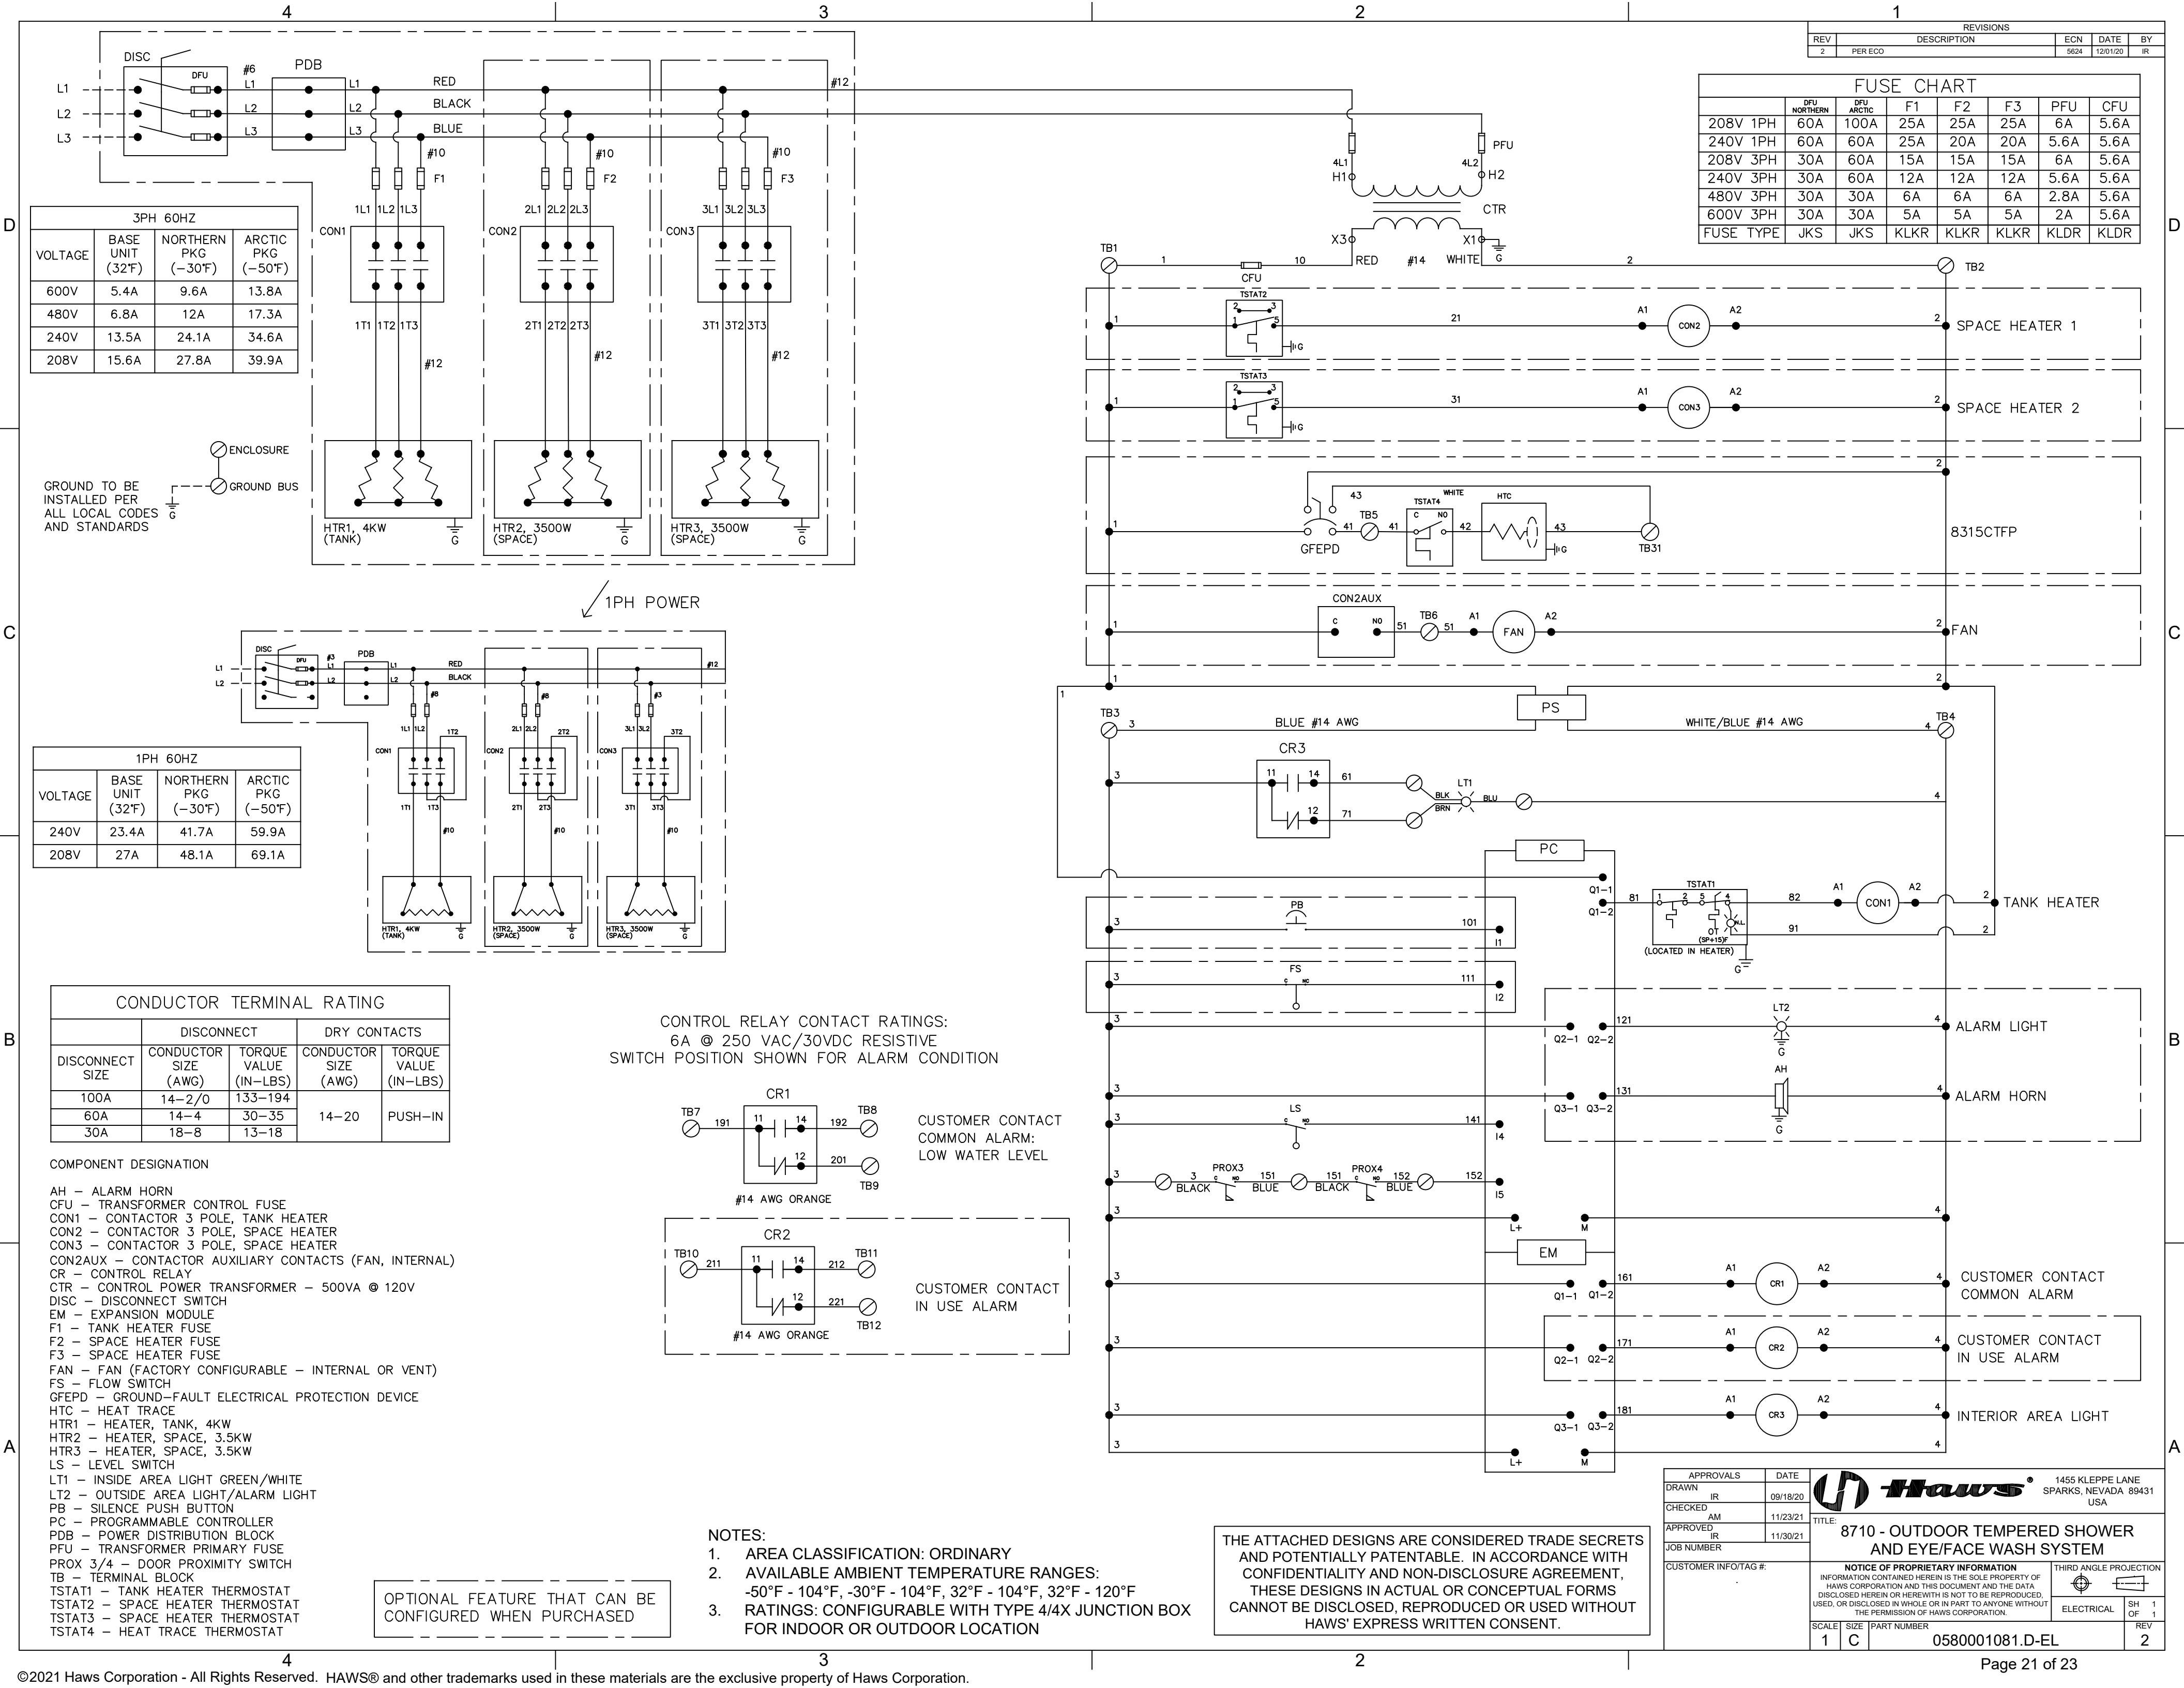


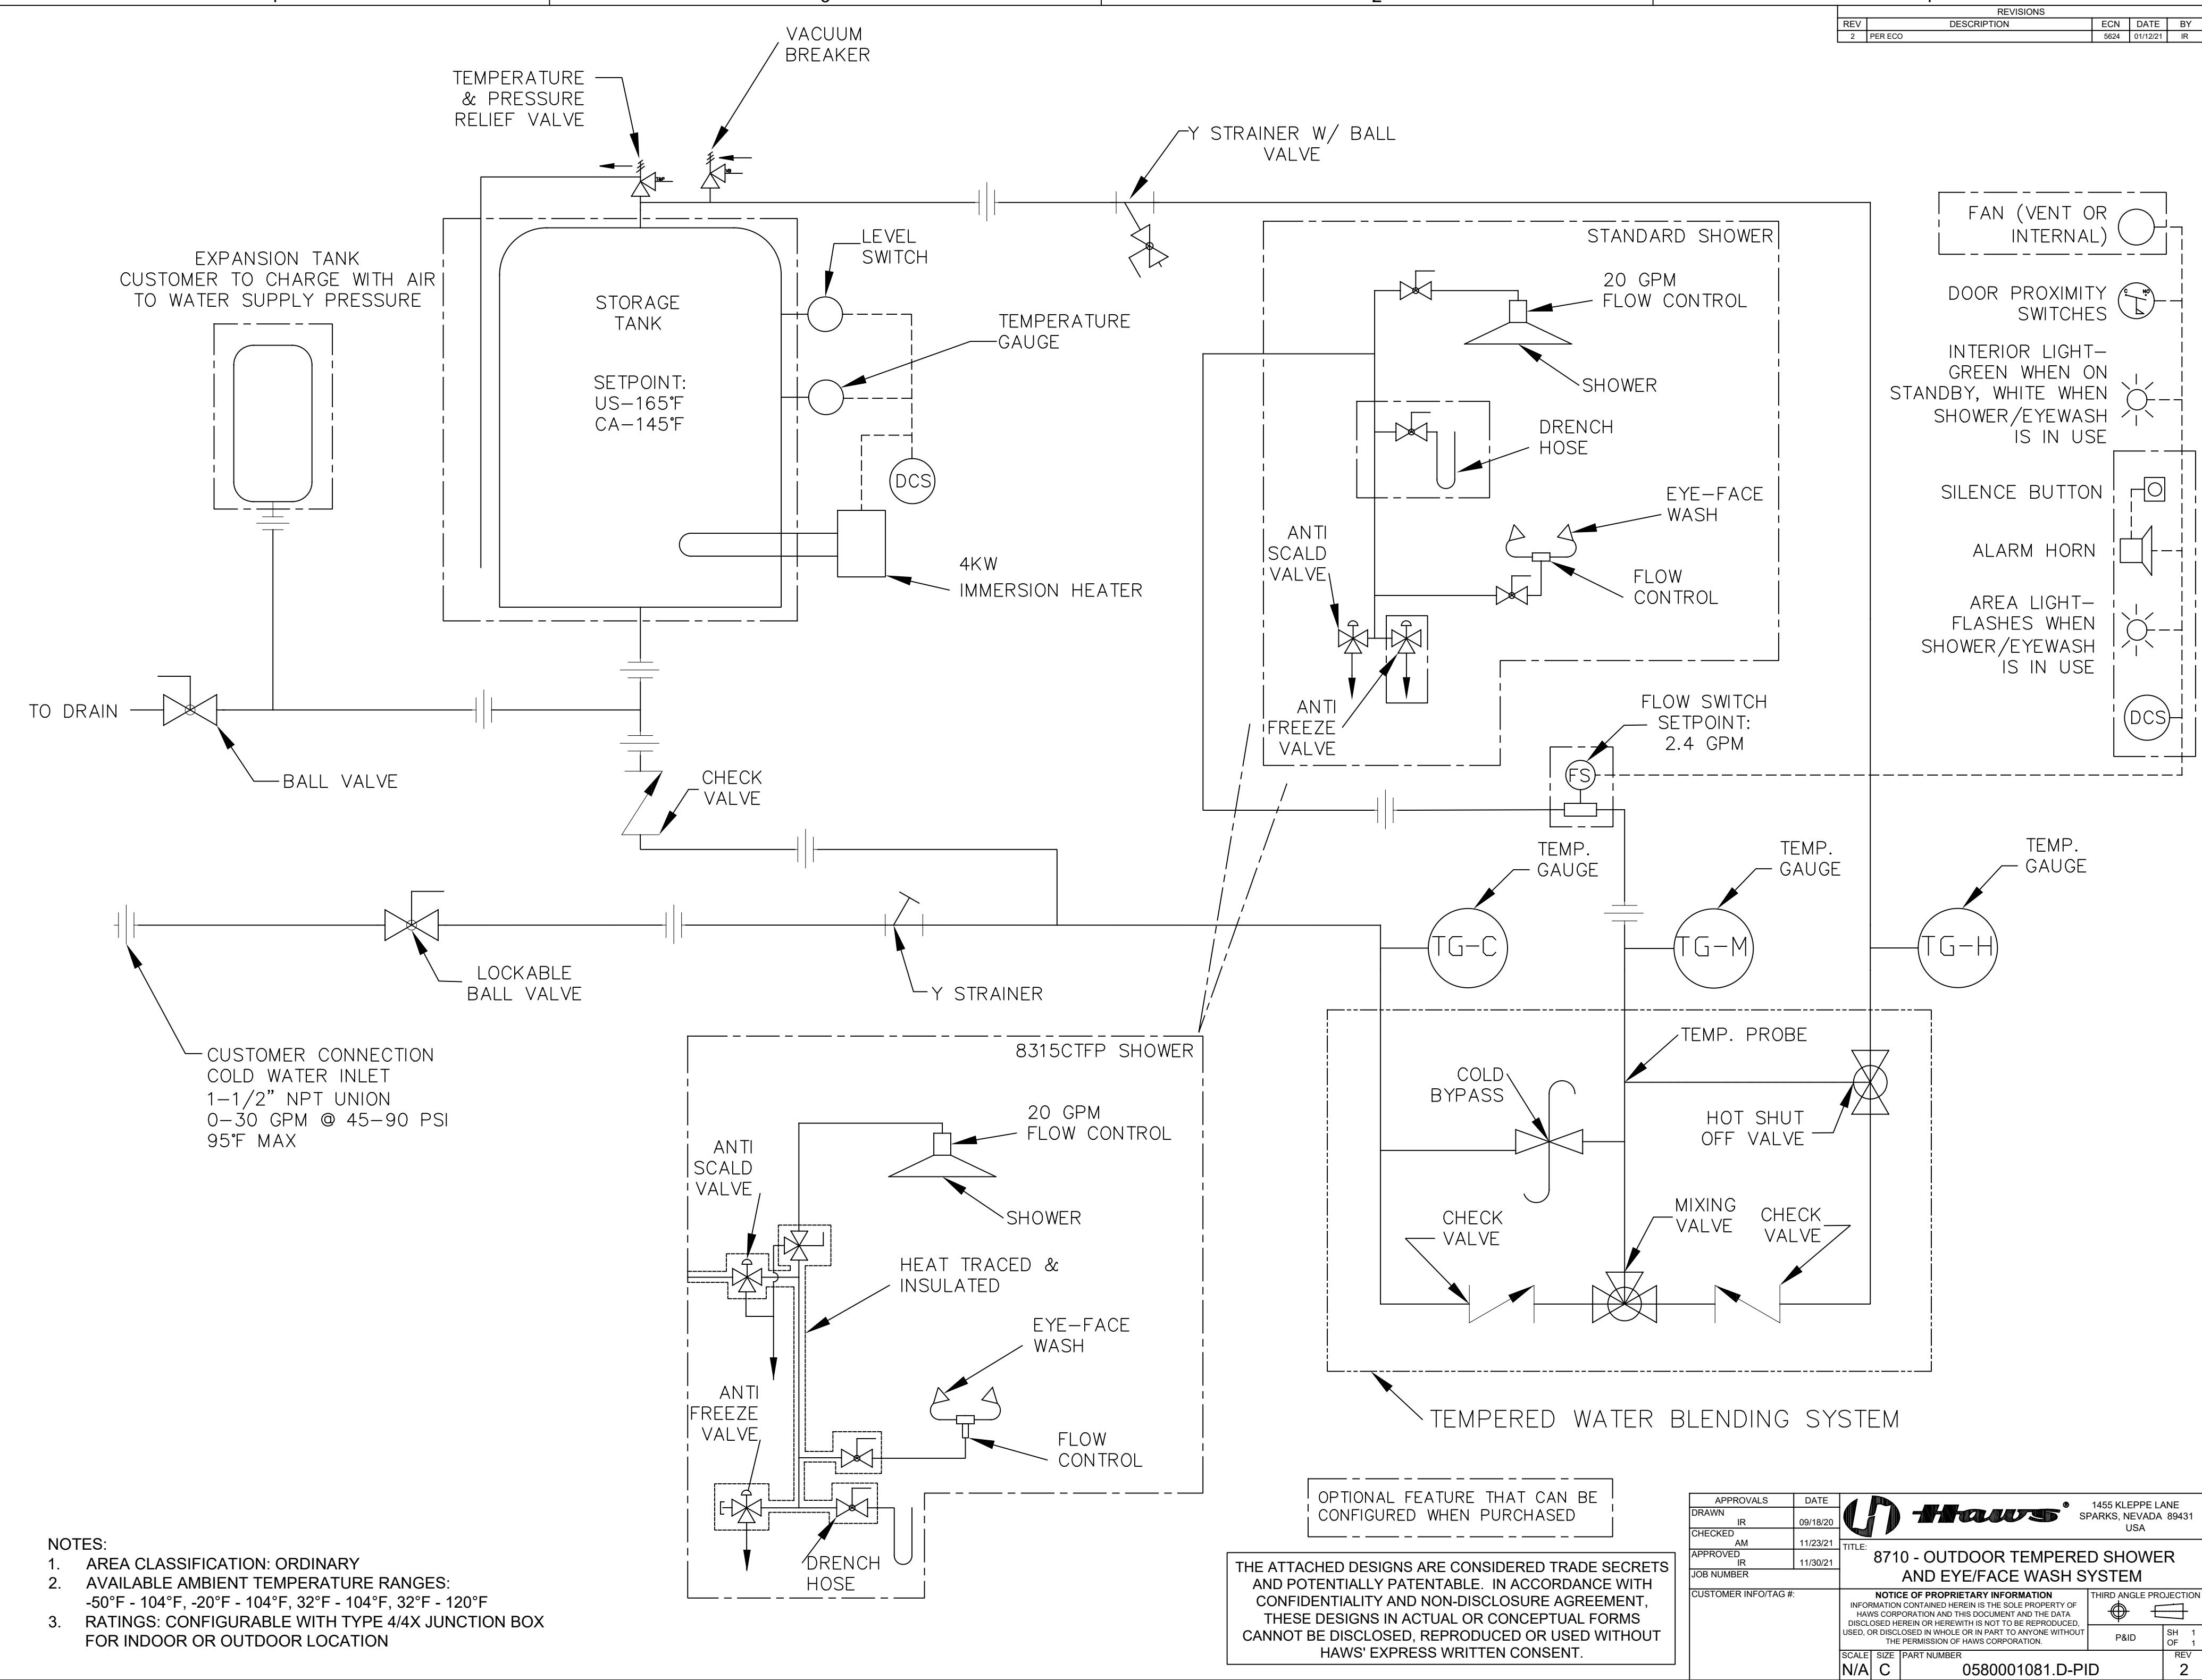


REVISIONS			
REV	DESCRIPTION	ECN	DATE
2	PER ECO	5624	01/12/21



- NOTES:
1. AREA CLASSIFICATION: ORDINARY
 2. AVAILABLE AMBIENT TEMPERATURE RANGES:
-50°F - 104°F, -20°F - 104°F, 32°F - 104°F, 32°F - 120°F
 3. RATINGS: CONFIGURABLE WITH TYPE 4/4X JUNCTION BOX FOR INDOOR OR OUTDOOR LOCATION

THE ATTACHED DESIGNS ARE CONSIDERED TRADE SECRETS AND POTENTIALLY PATENTABLE. IN ACCORDANCE WITH CONFIDENTIALITY AND NON-DISCLOSURE AGREEMENT, THESE DESIGNS IN ACTUAL OR CONCEPTUAL FORMS CANNOT BE DISCLOSED, REPRODUCED OR USED WITHOUT HAWS' EXPRESS WRITTEN CONSENT.

APPROVALS		DATE	 Haws 	1455 KLEPPE LANE SPARKS, NEVADA 89431 USA		
DRAWN	IR	09/18/20				
CHECKED	AM	11/23/21				
APPROVED	IR	11/30/21				
JOB NUMBER						
CUSTOMER INFO/TAG #:			TITLE: 8710 - OUTDOOR TEMPERED SHOWER AND EYE/FACE WASH SYSTEM			
			NOTICE OF PROPRIETARY INFORMATION INFORMATION CONTAINED HEREIN IS THE SOLE PROPERTY OF HAWS CORPORATION AND THIS DOCUMENT AND THE DATA DISCLOSED HEREIN OR HEREWITH IS NOT TO BE REPRODUCED, USED, OR DISCLOSED IN WHOLE OR IN PART TO ANYONE WITHOUT THE PERMISSION OF HAWS CORPORATION.		THIRD ANGLE PROJECTION  	
					P&ID SH OF 1	
			SCALE: N/A	SIZE: C	PART NUMBER: 0580001081.D-PID	REV: 2

LIMITED WARRANTY

HAWS warrants that this specific product is guaranteed against defective material or poor workmanship for a period of **one year from date of shipment**. HAWS liability under this warranty shall be discharged by furnishing without charge F.O.B. HAWS Factory any goods, or part thereof, which shall appear to the Company upon inspection to be of defective material or not of first class workmanship, provided that claim is made in writing to Haws within a reasonable period after receipt of the product. Where claims for defects are made, the defective part or parts shall be delivered to the Company, prepaid, for inspection. HAWS will not be liable for the cost of repairs, alterations, or replacements, or for any expense connected therewith made by the owner or his agents, except upon written authority from HAWS, Sparks, Nevada. HAWS will not be liable for any damages caused by defective materials or poor workmanship, except for replacements, as provided above. Buyer agrees that Haws has made no other warranties either expressed or implied in addition to those above stated, except that of title with respect to any of the products or equipment sold hereunder and that HAWS shall not be liable for general, special, or consequential damages claimed to arise under the contract of sale.

The emergency equipment manufactured by HAWS is warranted to function if installation and maintenance instructions provided are adhered to. The units also must be used for the purpose for which they were intended. This product is intended to supplement first-aid treatment. Due to widely varying conditions, Haws cannot guarantee that the use of this emergency equipment will prevent serious injury or the aggravation of existing or prior injuries.

NO OTHER WARRANTIES EXPRESSED OR IMPLIED ARE AUTHORIZED, PROVIDED OR GIVEN BY HAWS.

SHOULD YOU EXPERIENCE DIFFICULTY WITH THE INSTALLATION OF THIS MODEL PLEASE CALL:

HAWS SERVICES: 1-800-766-5612

FOR CUSTOMER SERVICE: 1-888-640-4297

For more information on Haws products, see our website: www.hawSCO.com

© 2021 Haws® Corporation – All Rights Reserved

HAWS® and other trademarks used in these materials are the exclusive property of Haws Corporation.