


NOTES:

- 1. DASHED LINES DENOTE FIELD PIPING (NOT SUPPLIED).
- 2. ELECTRICAL INSTALLATION SHOULD BE PERFORMED BY A QUALIFIED ELECTRICIAN.
- 3. TIGHTEN ENCLOSURE LID TO 177 IN-LBS (20Nm) AND TIGHTEN SET SCREW AFTER WIRING IS COMPLETE.
- 4. A SUPPLEMENTARY 7A FUSE IS REQUIRED FOR EACH INCOMING ELECTRICAL SUPPLY LINE WHEN INSTALLED IN A HAZARDOUS LOCATION.

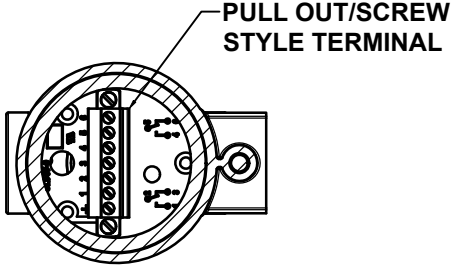

PIN	FUNCTION
EARTH	GND
1	NORMALLY OPEN (1)
2	COMMON (1)
3	NORMALLY CLOSED (1)
4	NORMALLY OPEN (2)
5	COMMON (2)
6	NORMALLY CLOSED (2)

SECTION A-A
SCALE 2:1

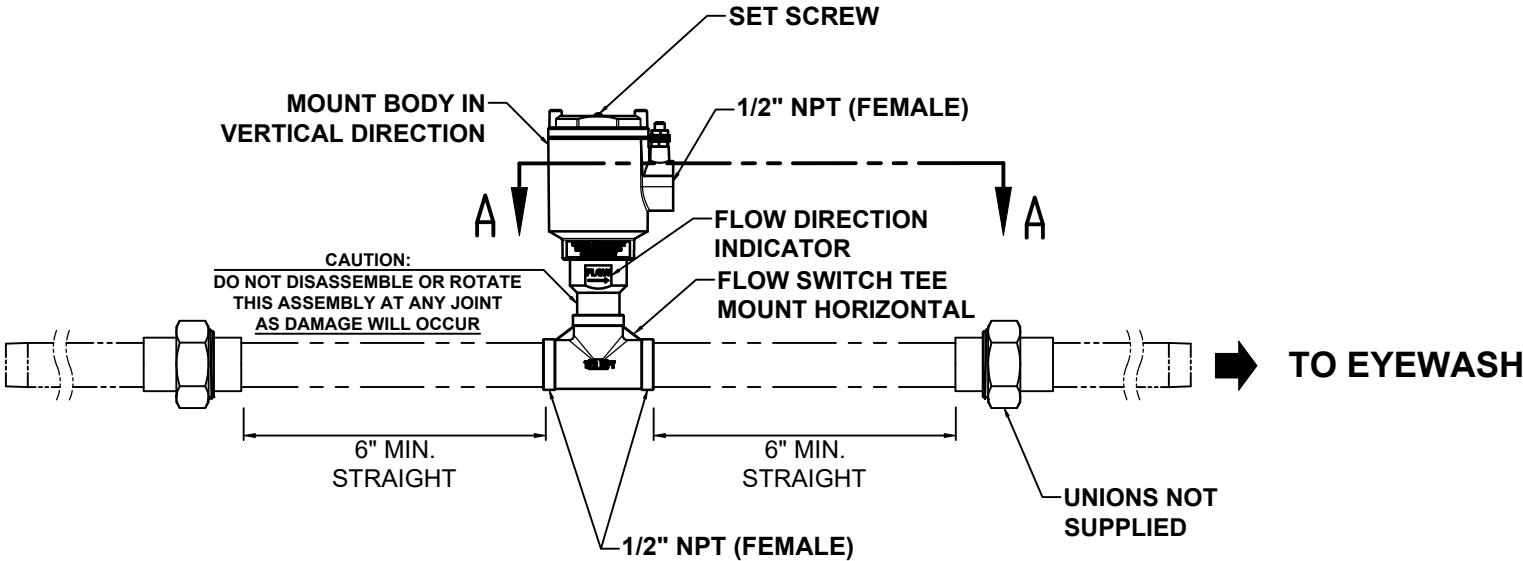



FIGURE 1



1455 KLEPPE LANE
SPARKS, NEVADA 89431
(775) 359-4712 FAX (775) 359-7424
E-MAIL: HAWS@HAWS.CO.COM
WEBSITE: WWW.HAWS.CO.COM

ECN NO.	REVISED PER	BY:	MODEL(S)	PART NUMBER
ECN: 6111	DN	DN	SP153DPDT	0510002286.D
DRAWN:	DATE:	CHK'D:		REVISION
DN	02/03/25	JU		1
APPROVED:	DATE:	SCALE:	DRAWING TYPE:	SHEET
DN	03/31/25	1:1	INSTALLATION	1 OF 1